



UNIVERSITY OF WISCONSIN  
OSHKOSH

# Door County Well Monitoring Program - Fall 2022 Summary

---

UW OSHKOSH

ENVIRONMENTAL RESEARCH AND INNOVATION CENTER

DECEMBER 12<sup>TH</sup>, 2022

# Program Goals


---

- Provide continued education on water resources in Door County, WI
- Provide avenue for residents and guests to have the most accurate information on their drinking water quality
- Provide reliable information to guide county resources for the protection and maintenance of drinking water resources
- Be proactive with respect to drinking water resources, rather than reactive
- Create a groundwater water quality database for Door County
- Establish trends in groundwater data over time

# Program Goals

---

- Target is at least one well per section (square mile) of Door County
- Spatially distributed data to look for trends and relationships
  - Soil type
  - Depth to bedrock
  - Water table depth
  - Land use

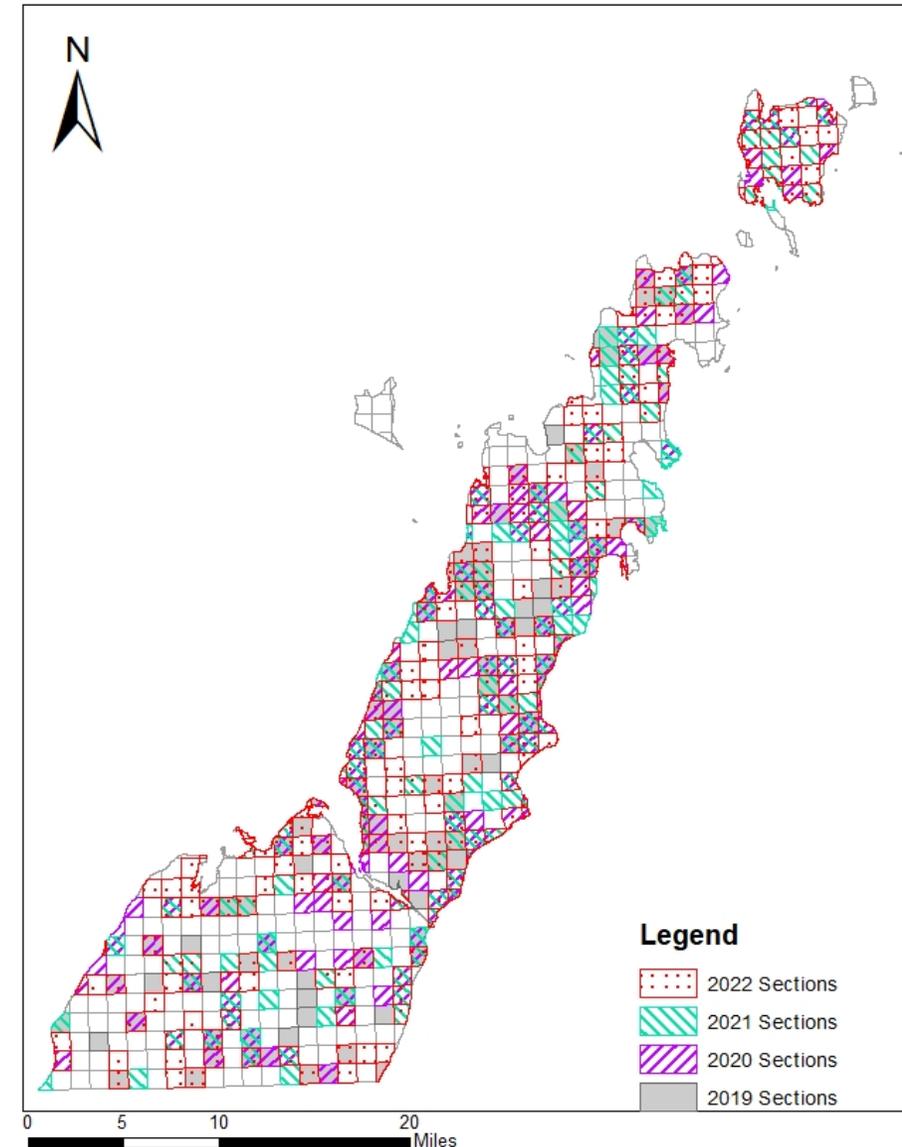


# Karst Geology & Groundwater Susceptibility


---

# Susceptibility

- Based on factors such as:
  - Bedrock depth
  - Soil type
  - Depth to water table

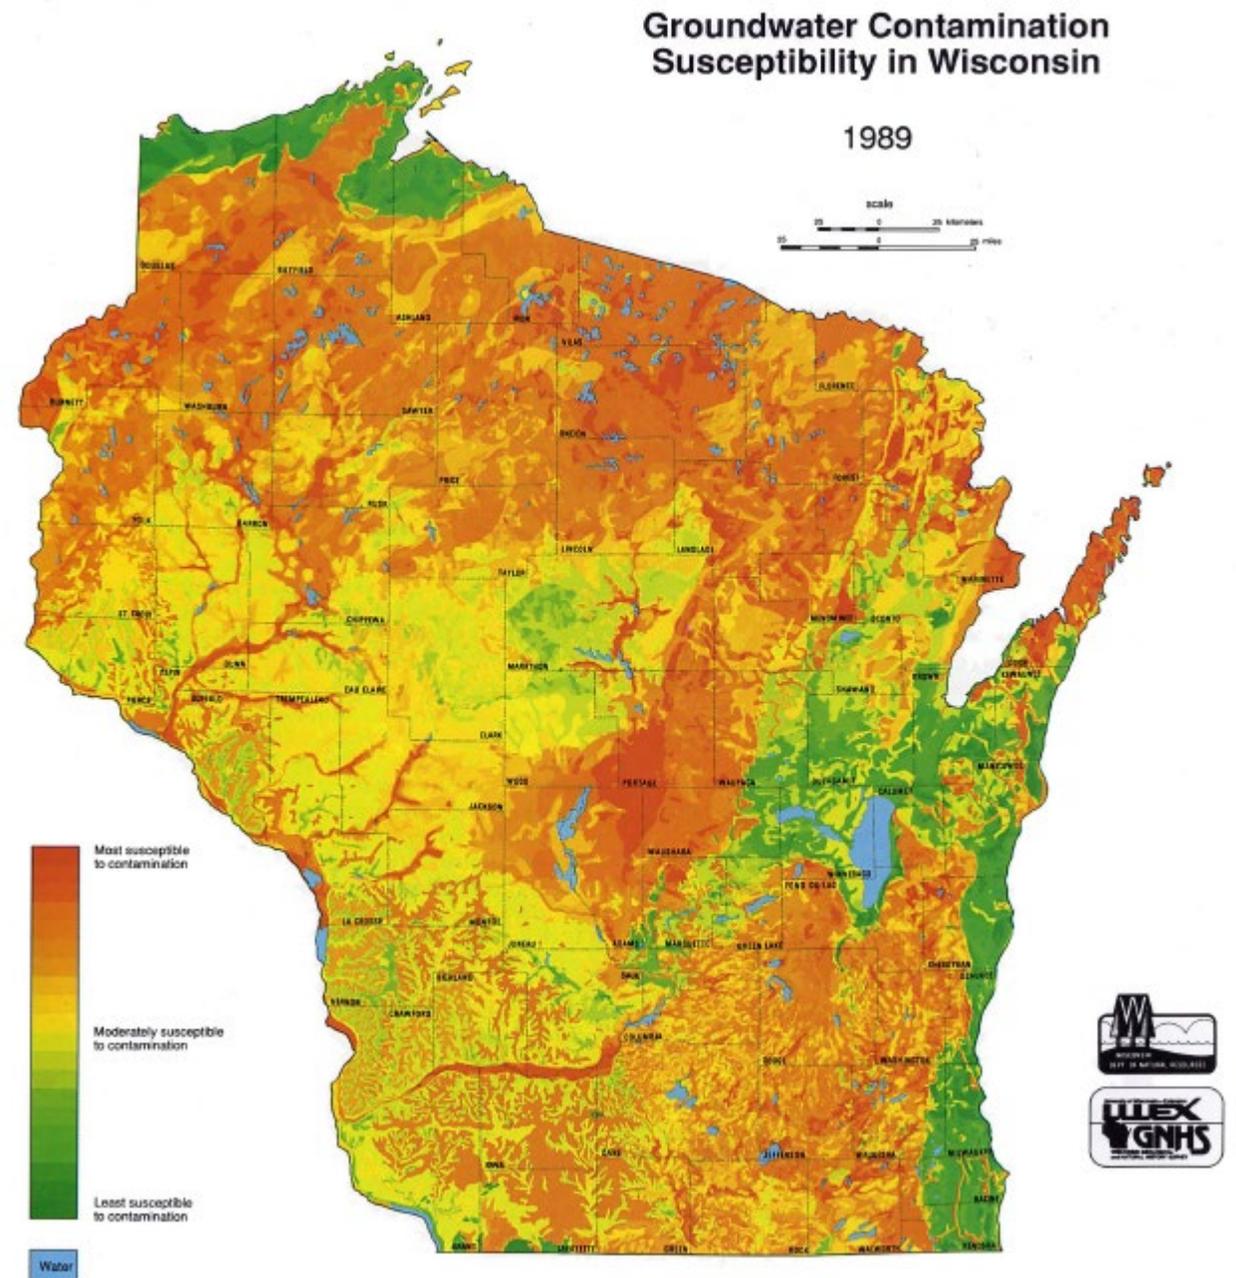

## Door County – Groundwater-Contamination Susceptibility Analysis

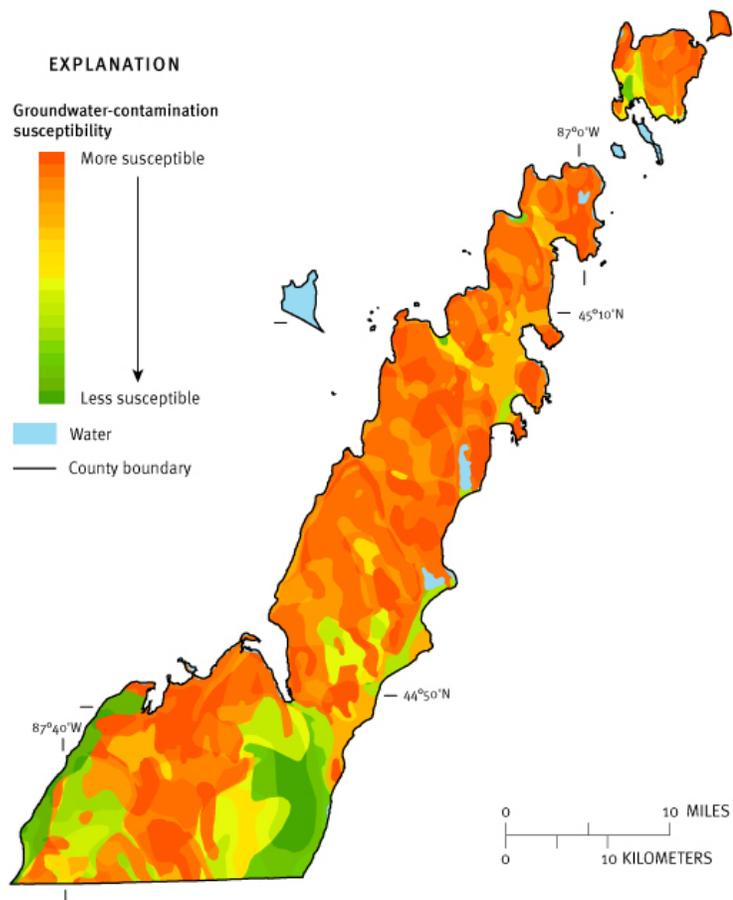


This groundwater-contamination susceptibility map is a composite of five resource characteristic maps, each of which was derived from generalized statewide information at small scales, and cannot be used for any site-specific purposes.

Map source: Schmidt, R.R., 1987, Groundwater contamination susceptibility map and evaluation: Wisconsin Department of Natural Resources, Wisconsin's Groundwater Management Plan Report 5, PUBL-WR-177-87, 27 p.

Figure created for the "Protecting Wisconsin's Groundwater Through Comprehensive Planning" web site, 2007, <http://wi.water.usgs.gov/gwcomp/>

## Door County – Depth to Water Table

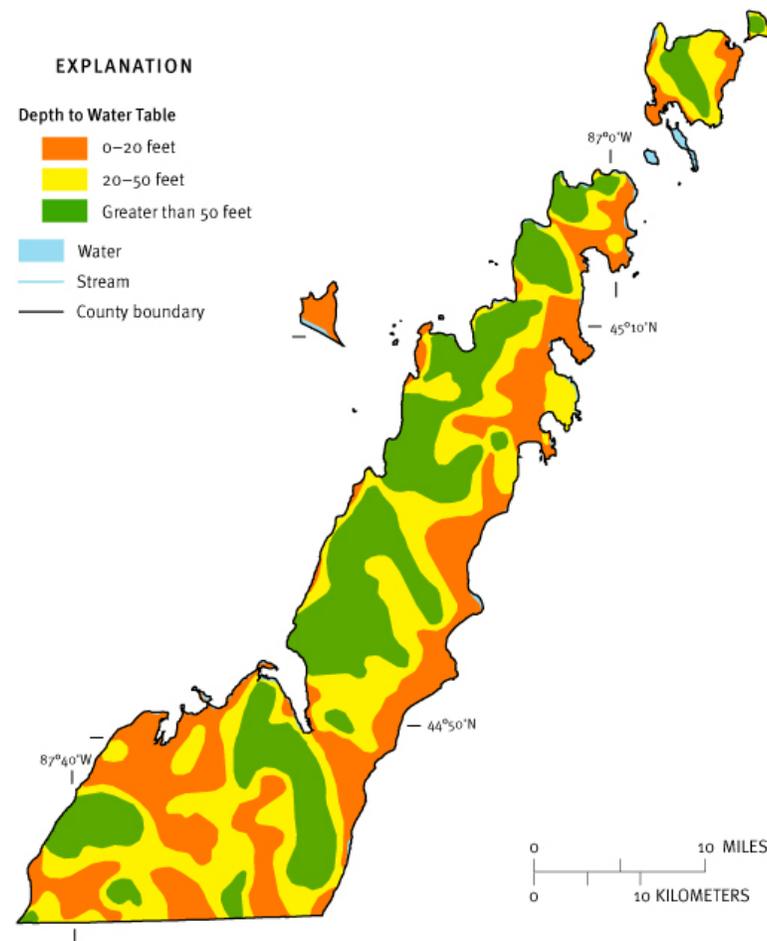

This resource characteristic map was derived from generalized statewide information at small scales, and cannot be used for any site-specific purposes.


Map source: Schmidt, R.R., 1987, Groundwater contamination susceptibility map and evaluation: Wisconsin Department of Natural Resources, Wisconsin's Groundwater Management Plan Report 5, PUBL-WR-177-87, 27 p.

Figure created for the "Protecting Wisconsin's Groundwater Through Comprehensive Planning" web site, 2007, <http://wi.water.usgs.gov/gwcomp/>

# What is Karst Geology?


---

- A landscape created when water dissolves rocks
- Made of dolomite and limestone

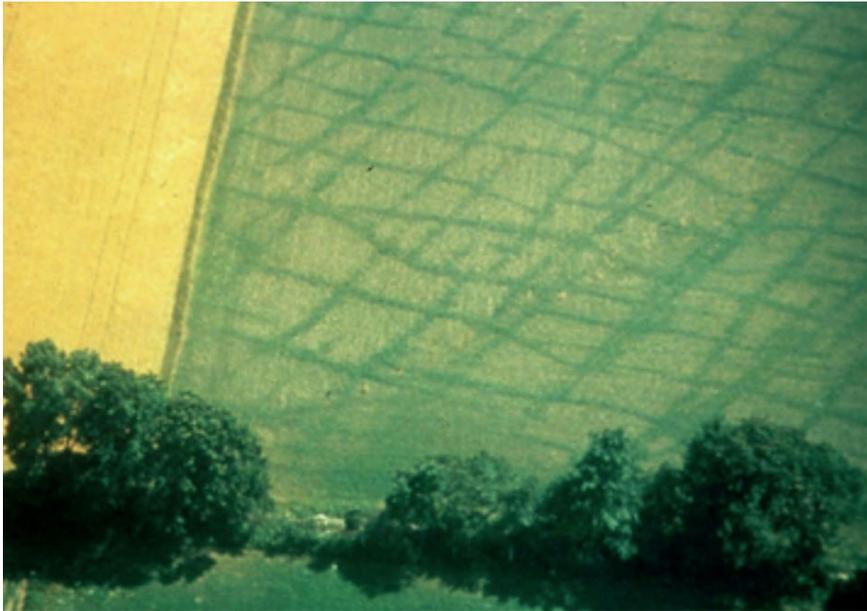

# Karst Geology Impact on Groundwater

---

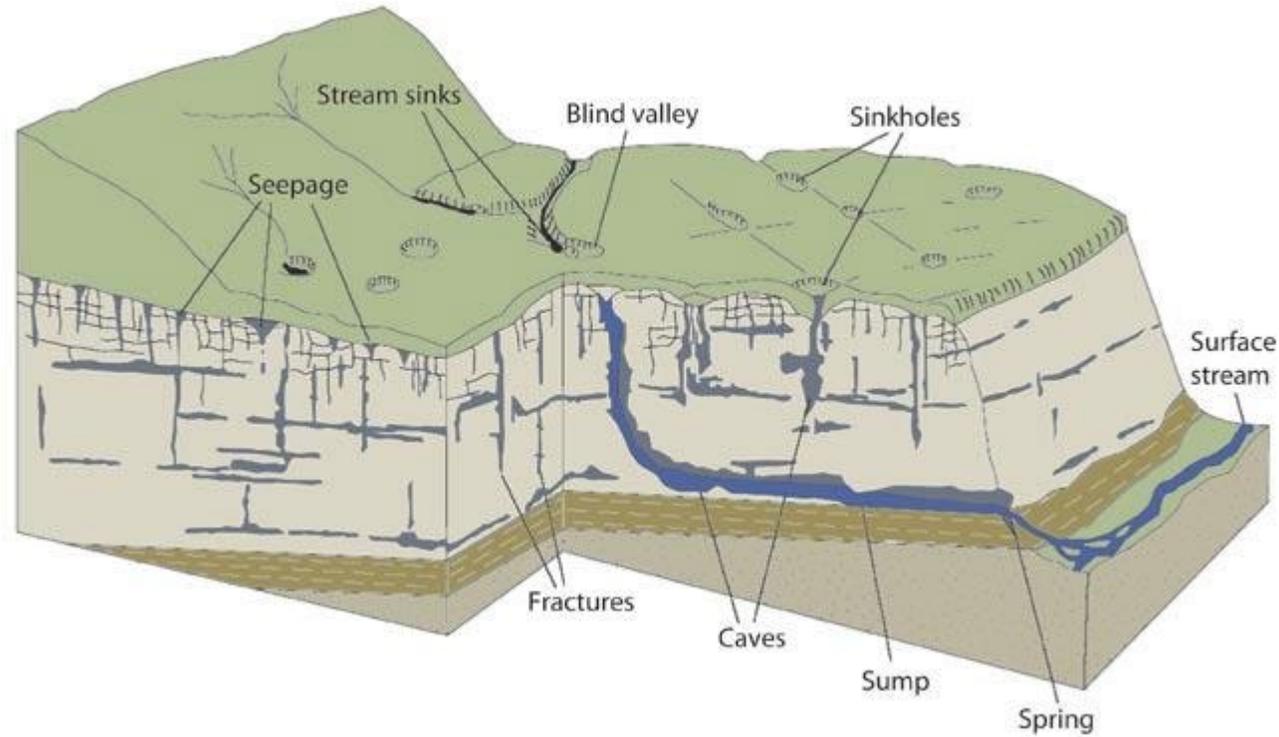

Karst Geology features as seen above create direct conduits to groundwater, where contaminants can easily make their way into our drinking water

# U.S. Karst Map



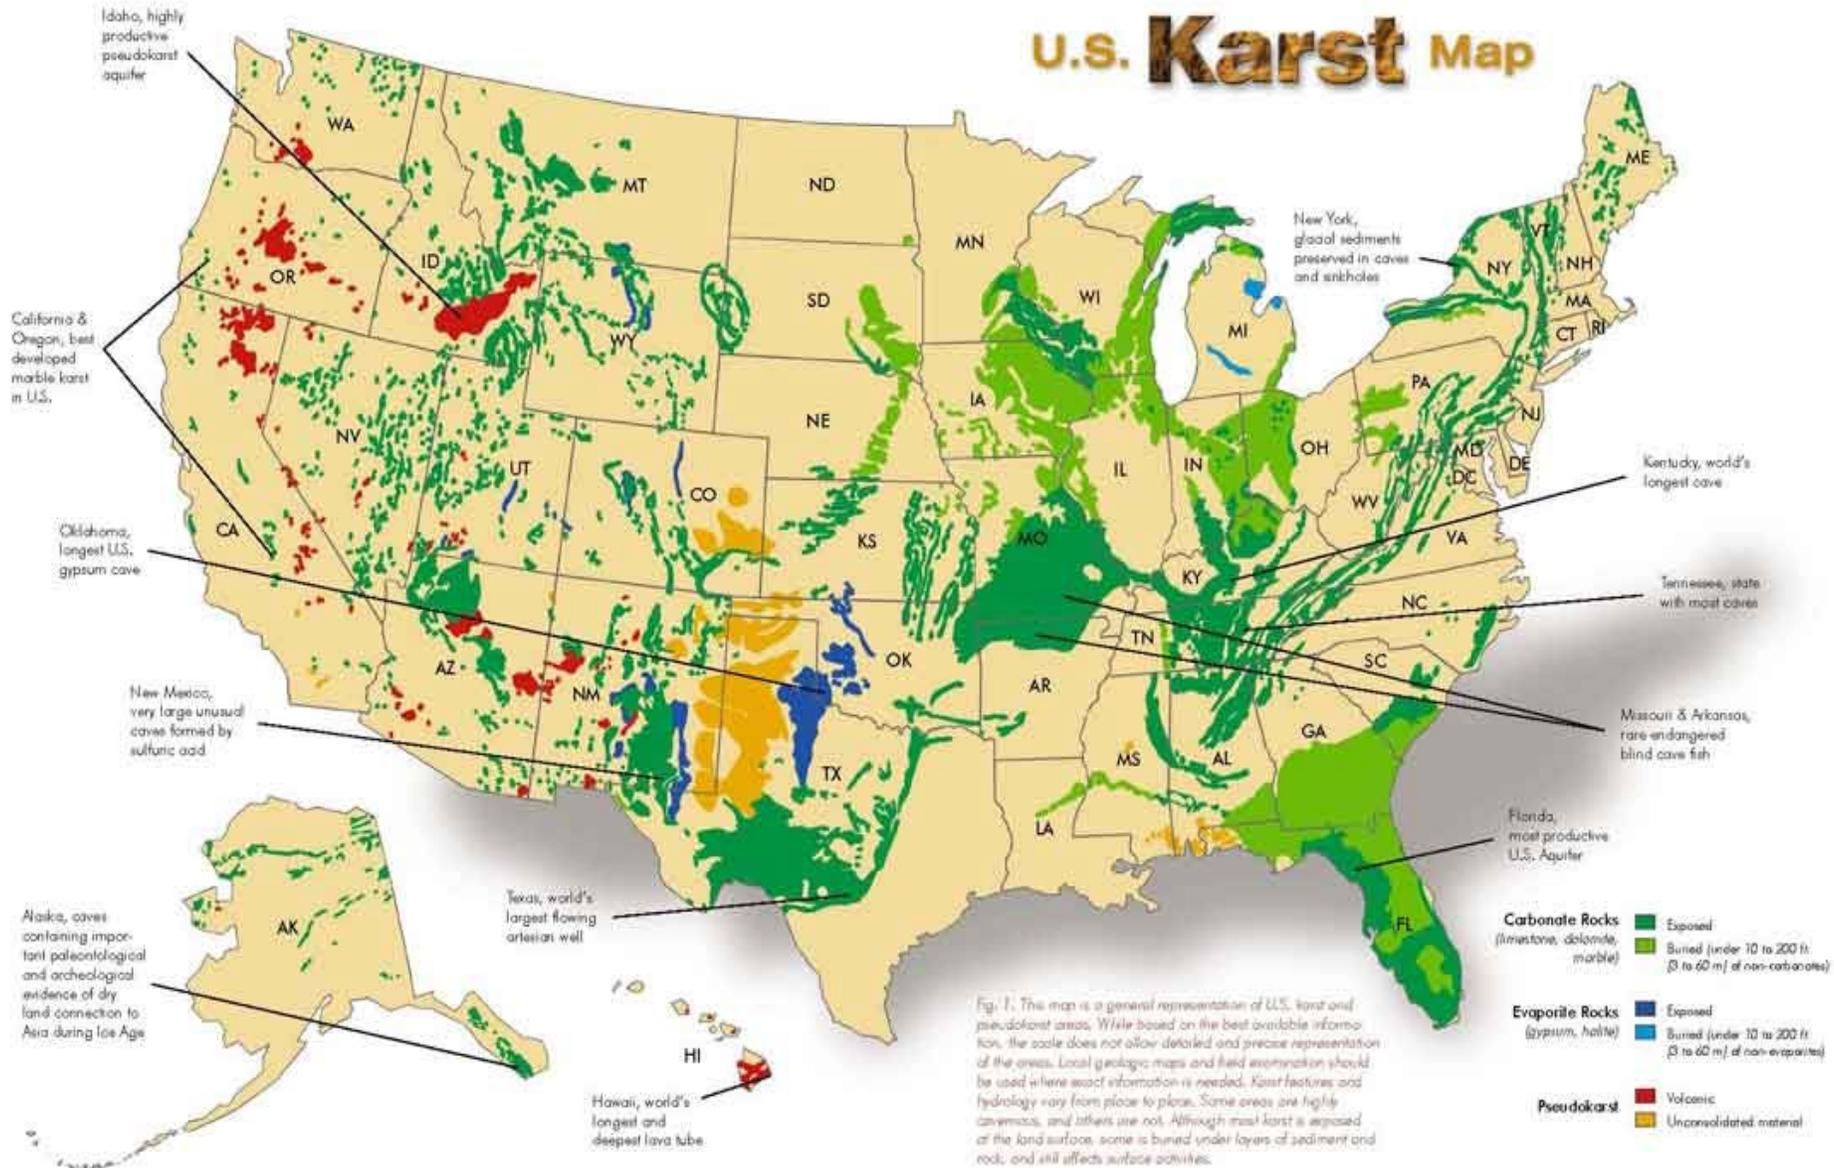


Fig. 1. This map is a general representation of U.S. karst and pseudokarst areas. While based on the best available information, the scale does not allow detailed and precise representation of the areas. Local geologic maps and field examination should be used where exact information is needed. Karst features and hydrology vary from place to place. Some areas are highly cavernous, and others are not. Although most karst is exposed at the land surface, some is buried under layers of sediment and rock, and still affects surface activities.

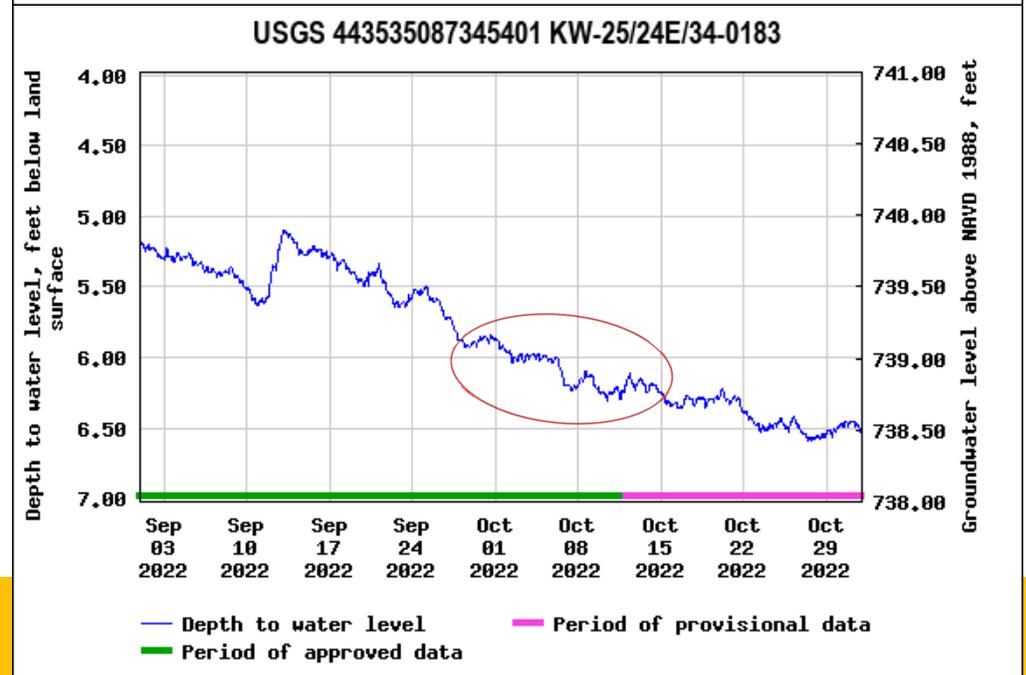

# Groundwater Recharge

- Study design requires samples to be collected in a narrow window of time (within ~30 hours) – **but why?**
  - Reduce any variables in groundwater quality
    - Weather conditions
    - Groundwater conditions – dry period or recharge period
    - Greater effects with karst geology

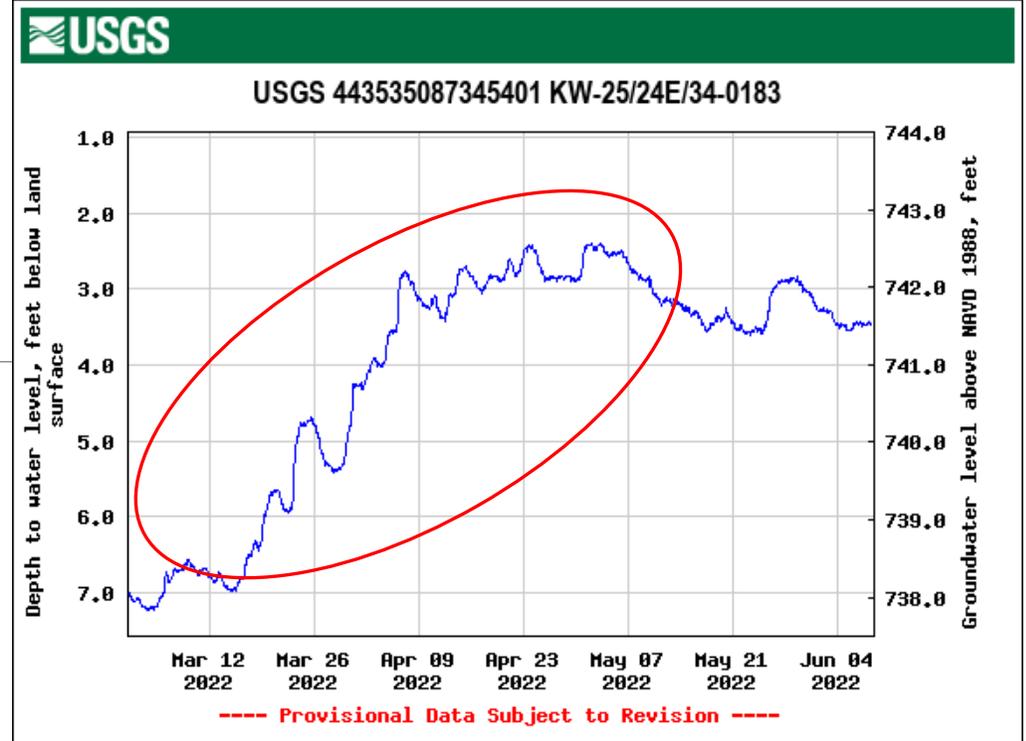

# Testing Parameters

---



# Bacteria


---

- Feces contain millions of microorganisms/gram
- Pathogens (disease-causing) usually found in low numbers
- Pathogens are more difficult than indicator organisms to recover and identify in the lab
- Pathogens can be bacteria (*E.coli*), viruses (Norovirus), or protozoans (*Cryptosporidium*)
- We look for fecal indicator organisms that “indicate” that a recent contamination has occurred (which suggests that pathogens also are likely present)



Bacteriological contamination in private wells throughout Wisconsin – percent positive by county

-Can be caused by several factors

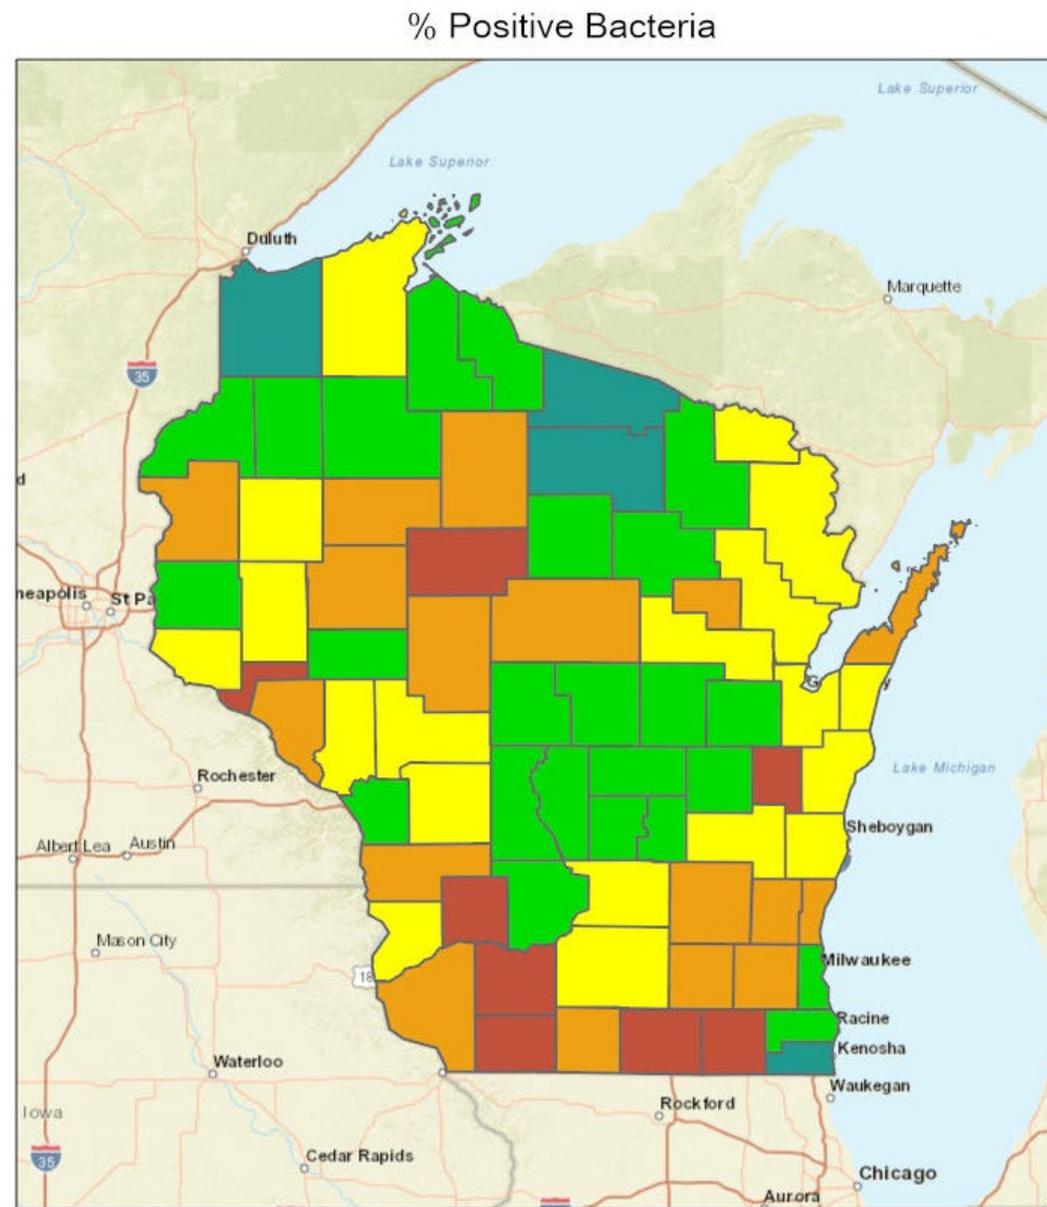


November 26, 2019

Bacteria - Percent - Positive by County

5.1% - 10%  
10.1% - 15%


15.1% - 20%  
20.1% - 25%  
25.1% ...



# Sources of Bacteria


- Sources

- Improperly constructed well
- Older or damaged well
- Distribution system issue (cracked pipe, dead end, etc)
- Outside source of bacteria (agriculture, animal waste, human waste)

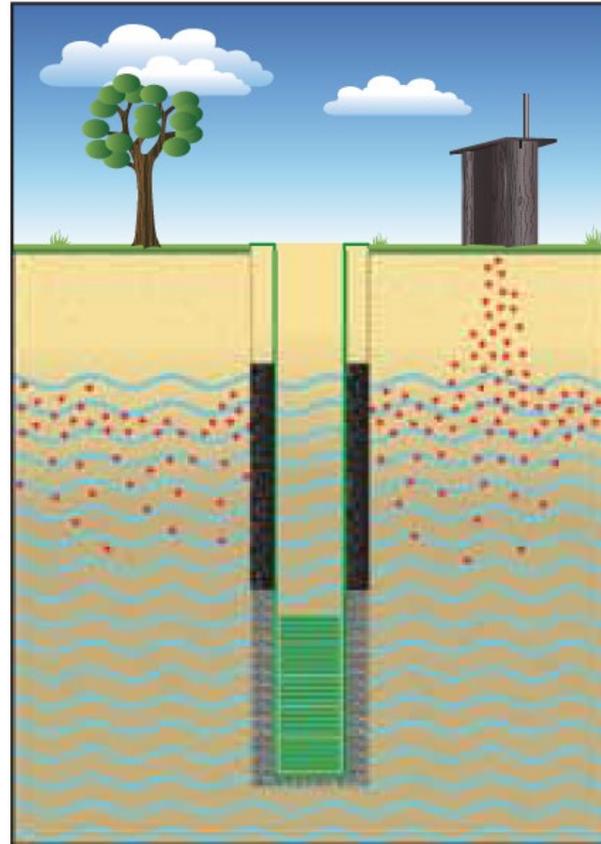

Sanitary Well



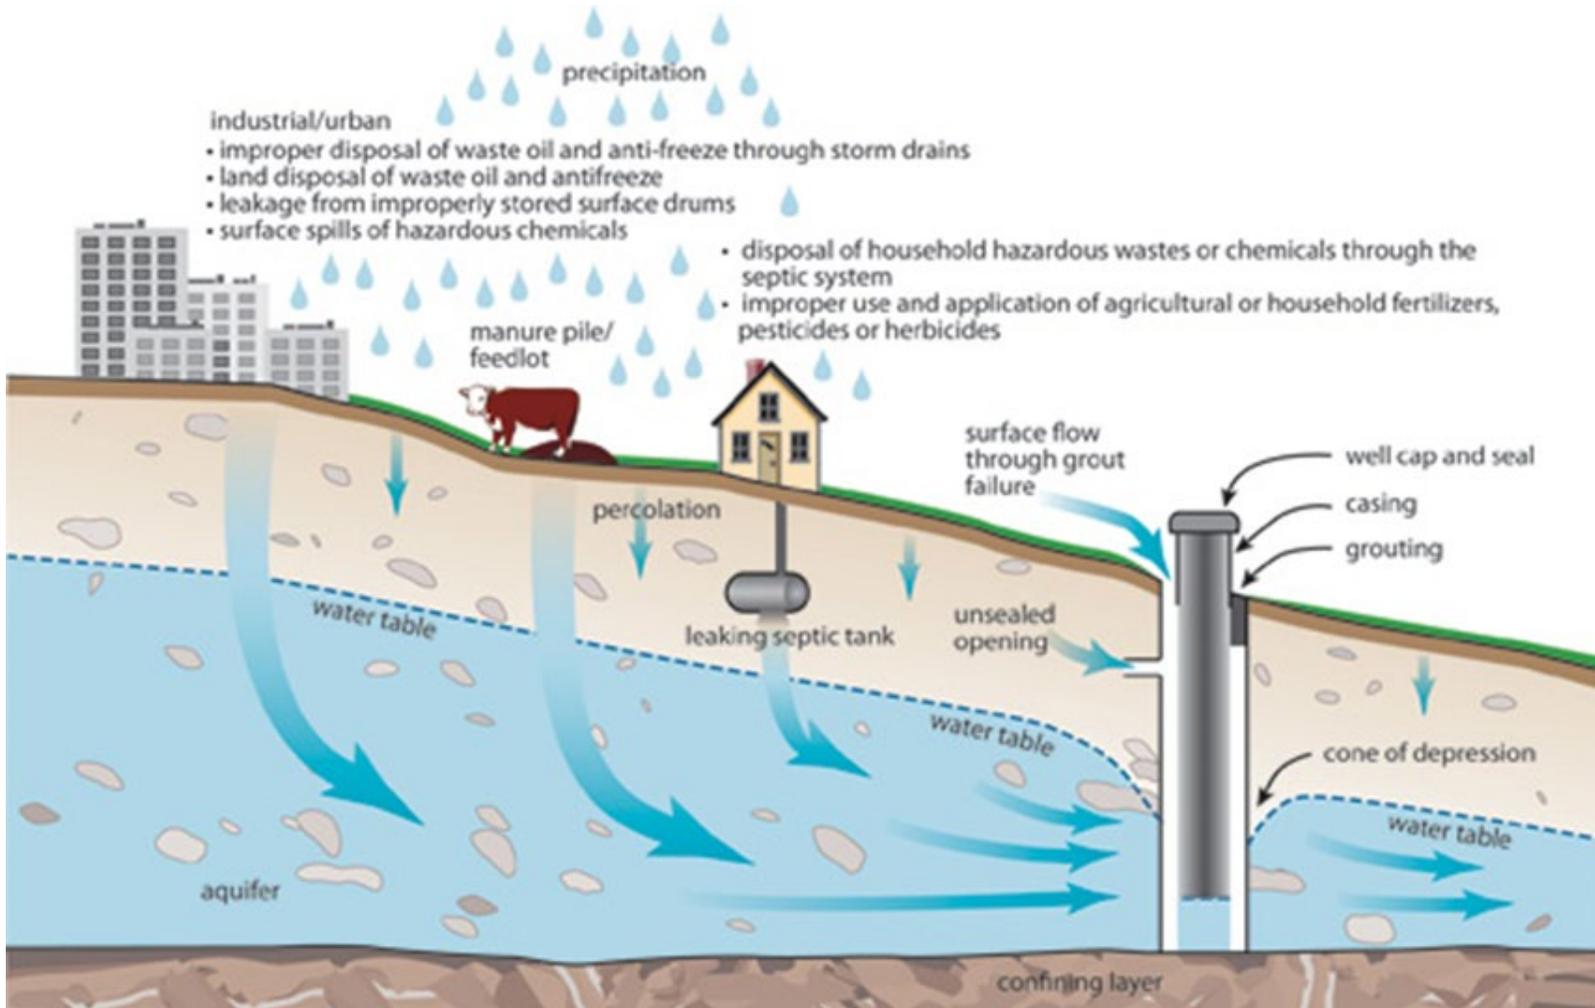


# Sources of Bacteria

---

# Nitrate

- Formed when nitrogen combines with oxygen in water
- Soluble – commonly found in runoff

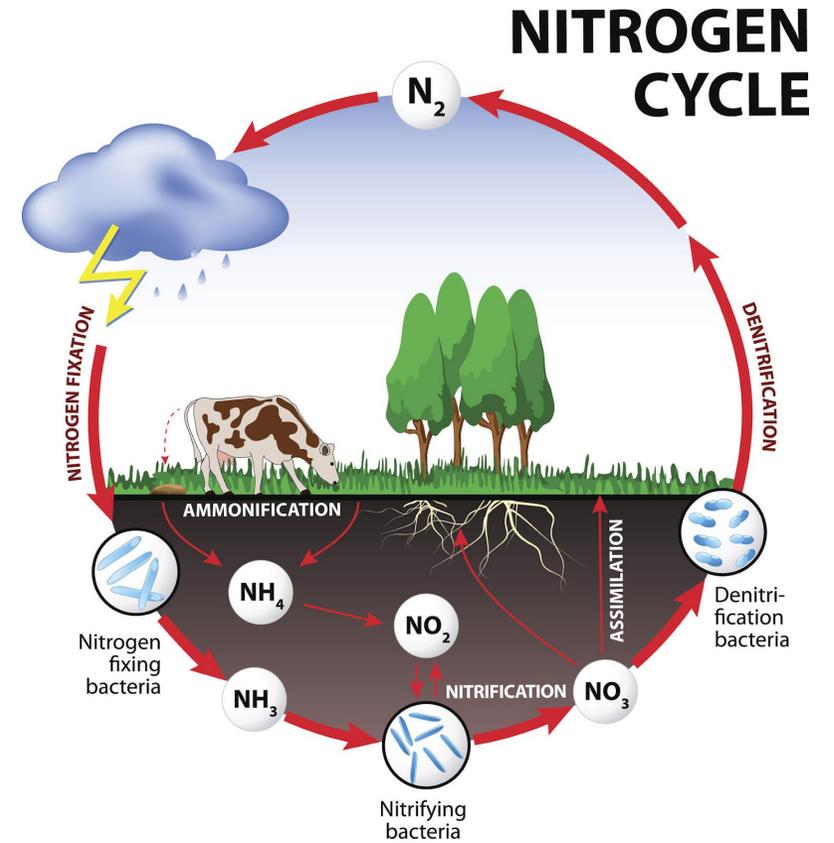




# Nitrate

- Sources

- Agriculture (manure and/or fertilizer)
- Sewage/Septic
- Animal waste
- Atmospheric (trace amounts)
- Lawn care (fertilizer)
- Very low naturally occurring nitrate

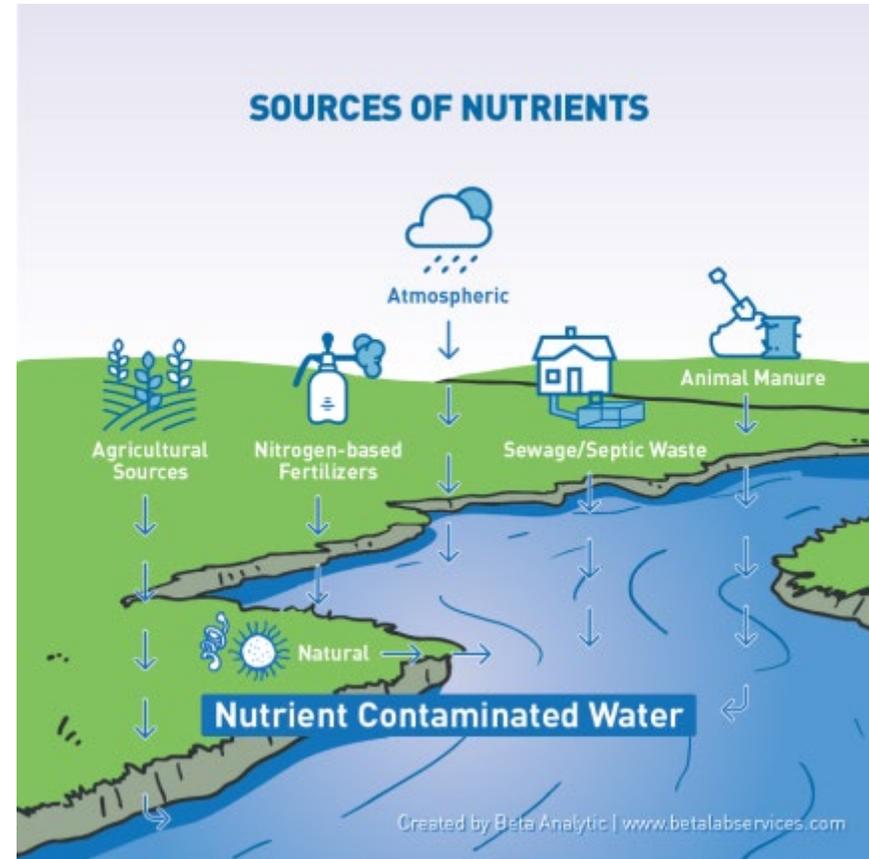


# Arsenic

- Sources

- Most naturally occurring in bedrock
- Lead arsenate pesticides were used in orchards from 1890s-1960s (binds to soil, does not usually migrate into groundwater)

## Arsenic contamination persists in groundwater

Arsenic is a major concern in Outagamie and Winnebago counties, where Wisconsin established an arsenic advisory area in 1993 and introduced stricter regulation in 2004 and 2014.

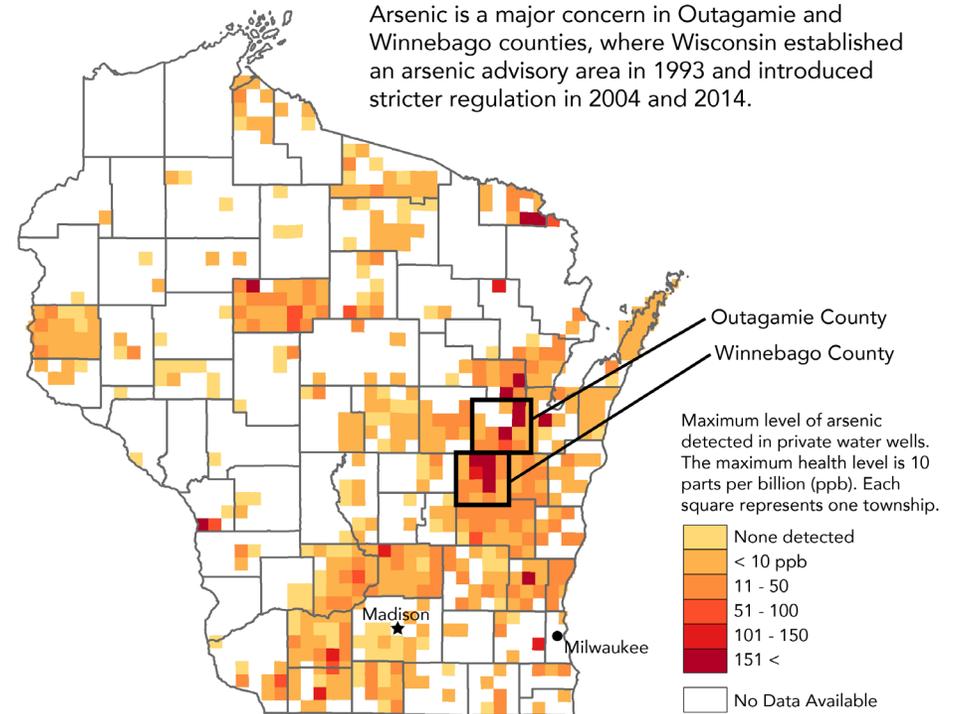

CREDIT: Katie Kowalsky/Wisconsin Center for Investigative Journalism

SOURCES: Well Water Quality Viewer, University of Wisconsin-Stevens Point's Center for Watershed Science and Education; Wisconsin Department of Natural Resources "Arsenic in Drinking Water" brochure.

# Interpreting Results


---



# How much is one part per ...

million (ppm)

milligrams/liter (mg/L)



= three drops added to a  
42-gallon barrel

billion (ppb)

micrograms/liter ( $\mu\text{g/L}$ )



*length = 35 feet, diameter = 8 feet*

= one drop added to  
a large tanker truck

quadrillion (ppq)


picograms/liter (pg/L)



*Area = 1000 sq mi  
Average depth = 13 ft*

trillion (ppt)

nanograms/liter (ng/L)

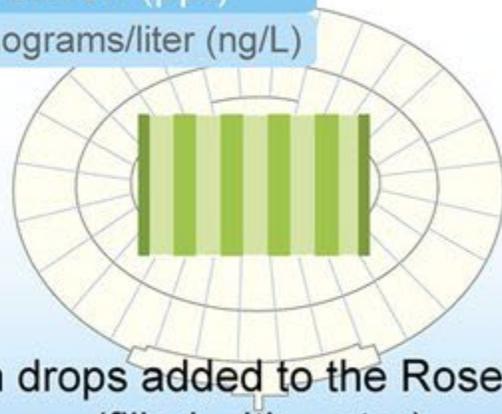

= ten drops added to the Rose Bowl  
(filled with water)

= two teaspoons added to the  
Great Salt Lake of Utah

# What's considered unsafe?

---

| Parameter   | Maximum Contaminant Level (MCL) | "Unsafe" Levels* |
|---|---------------------------------|------------------|
| Total Coliform  | 0 MPN/100 mL                    | > 0 MPN/100 mL   |
| <i>E. coli</i>  | 0 MPN/100 mL                    | > 0 MPN/100 mL   |
| Nitrate   | 10 mg/L                         | > 10 mg/L        |
| Arsenic   | 10 µg/L                         | > 10 µg/L        |
| * "Unsafe" Levels refers to samples that exceed the MCL |                                 |                  |

# Interpreting Results

---

## BACTERIA

- Tested for presence of Coliform and *E. coli* bacteria
- A negative or “0” result: there is no bacteria present in the sample and it is safe to drink
- A positive or any number: bacteria is present in the sample, and it is unsafe to drink

## NITRATE

- “ND”: nitrate was not detected in the sample; water is safe to drink
- Between 0-9.9 mg/L: nitrate was detected in the “safe” range
- Over 10 mg/L: nitrate was detected over the “safe” range, water is unsafe to drink

# Interpreting Results

---


## ARSENIC

- ND: arsenic was not detected in the sample
- Between 0-10  $\mu\text{g/L}$ : arsenic was detected in the “safe” range
- Over 10  $\mu\text{g/L}$ : arsenic was detected over the “safe” range

# Interpreting Results

## CUMULATIVE

**pH:** measure of the acid-base balance. Carbon dioxide concentration & increase in temperature can decrease pH of water.

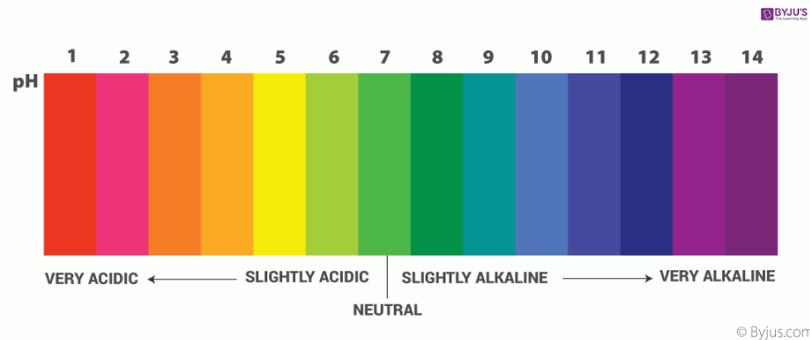

**Iron:** a metal element that makes up 5% of the earth's crust. Iron is not considered hazardous to health. Recommended level is less than 0.3 mg/L

**Hardness:** water's ability to react with soap and produce a lather. Caused by ions such as calcium and magnesium. Not considered hazardous to health. Hard water can cause lime buildup/scaling on plumbing fixtures.

| Water Hardness Scale |                |                 |
|----------------------|----------------|-----------------|
| Grains/Gal           | mg/L & ppm     | Classification  |
| Less than 1          | Less than 17.1 | Soft            |
| 1 – 3.5              | 17.1 - 60      | Slightly Hard   |
| 3.5 - 7              | 60 - 120       | Moderately Hard |
| 7 - 10               | 120 - 180      | Hard            |
| Over 10              | Over 180       | Very Hard       |

**Alkalinity:** water's ability to neutralize acids. Can be affected by natural deposits in the earth and industrial practices. It is not considered to be hazardous to health. Recommended level is between 75-200 mg/L


# Fall 2022 Results

---




# Coliform Bacteria

| Coliform Result (MPN/100 mL) | # Samples | % Samples |
|------------------------------|-----------|-----------|
| 0                            | 180       | 92        |
| 1-10                         | 12        | 6         |
| 10-100                       | 3         | 2         |
| 100+                         | 1         | 1         |
| n=196                        |           |           |

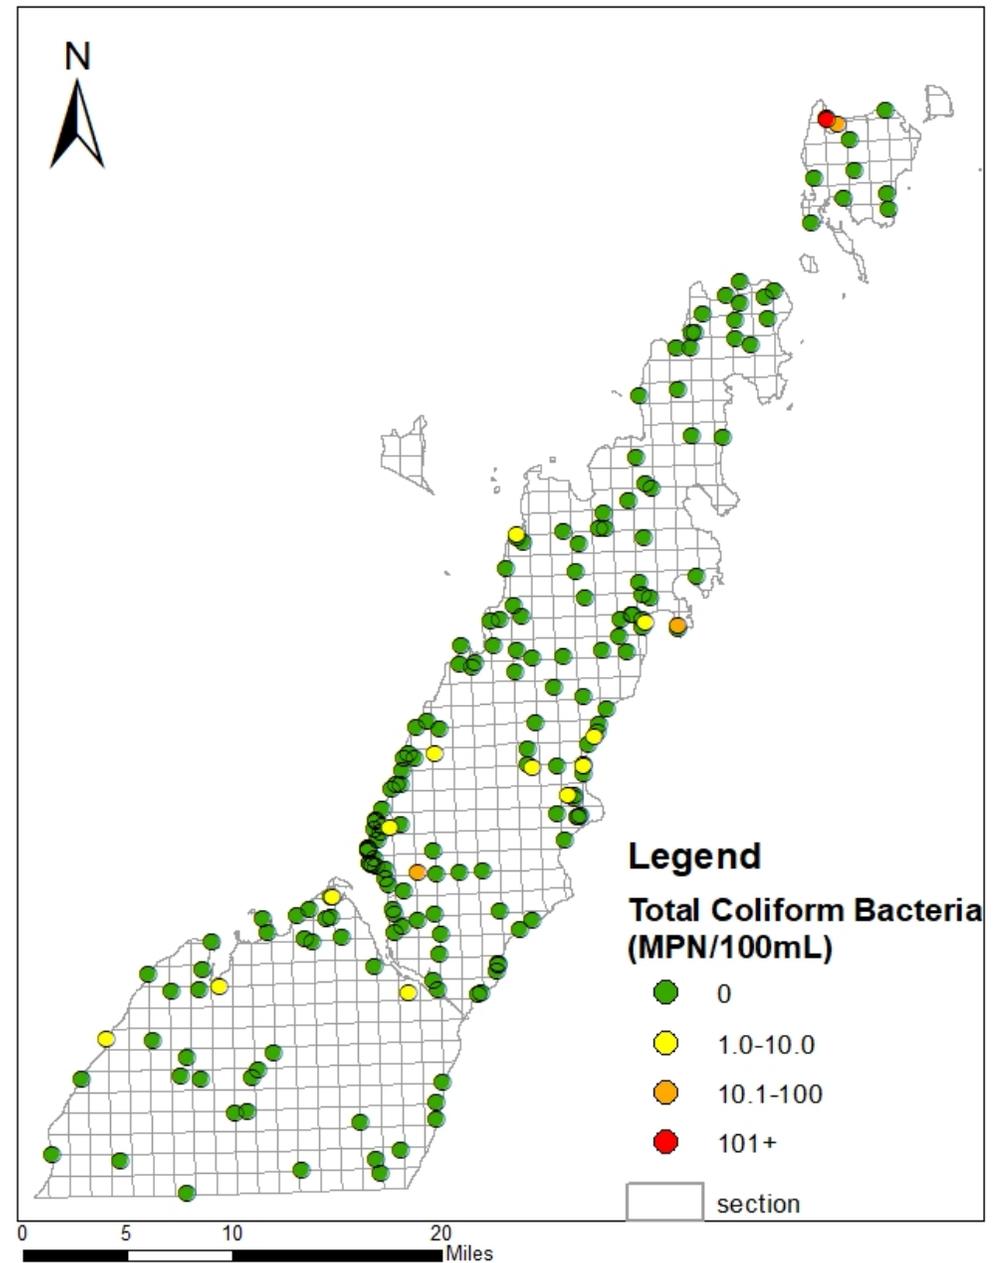


# *E. Coli* Bacteria

| <i>E coli</i> Result<br>(MPN/100 mL) | # Samples | % Samples |
|--------------------------------------|-----------|-----------|
| 0                                    | 196       | 100       |
| 1-10                                 | 0         | 0         |
| 10-100                               | 0         | 0         |
| 100+                                 | 0         | 0         |
| n=196                                |           |           |

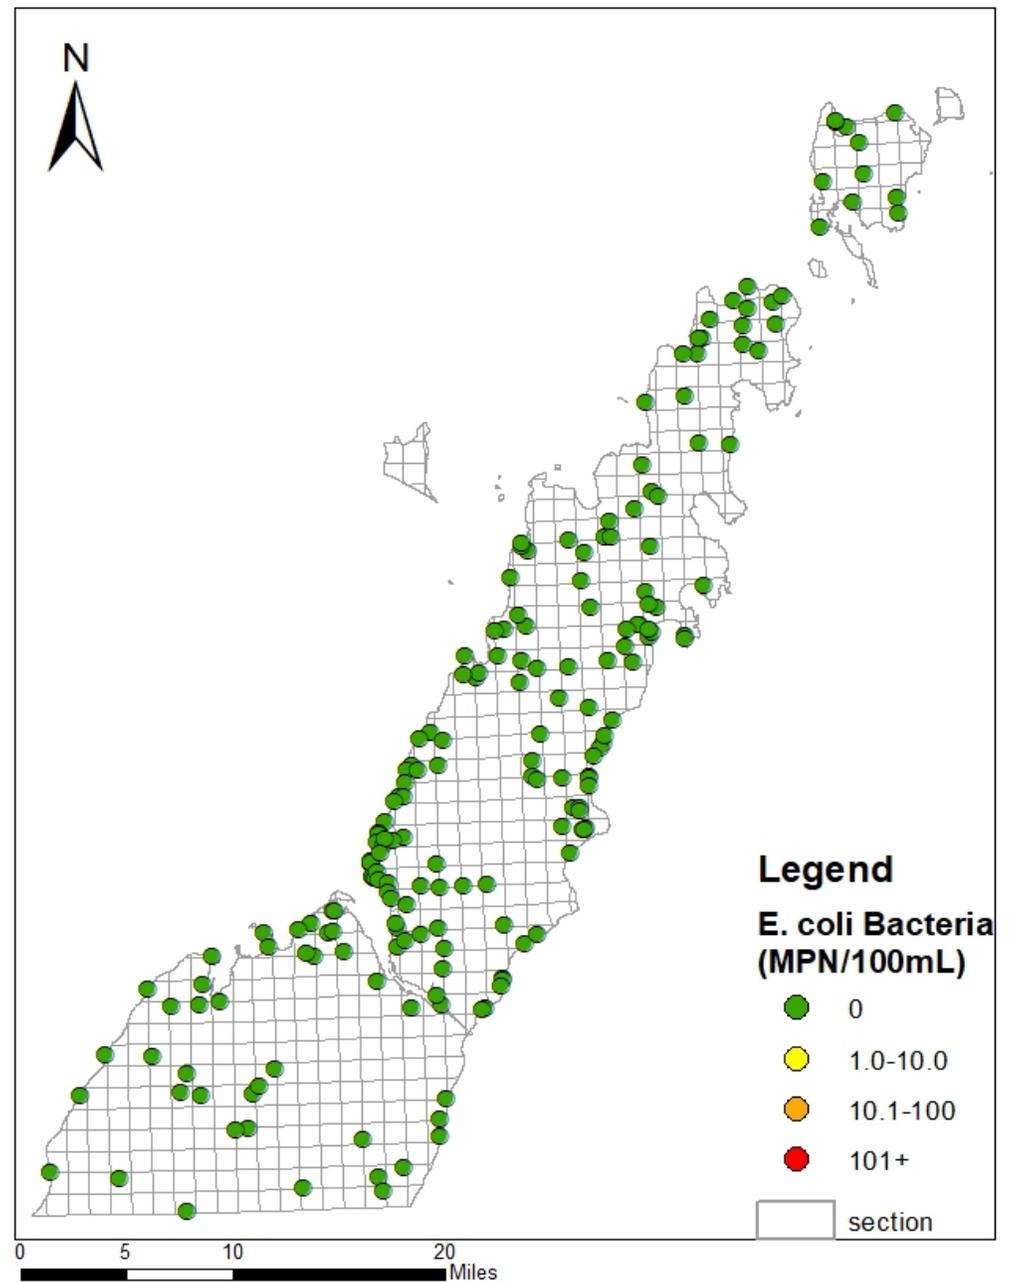


# Nitrate

| Nitrate Result (mg/L) | # Samples | % Samples |
|-----------------------|-----------|-----------|
| Less than 2           | 144       | 74        |
| 2-5                   | 35        | 18        |
| 5-10                  | 14        | 7         |
| 10+                   | 2         | 1         |
| n=195                 |           |           |

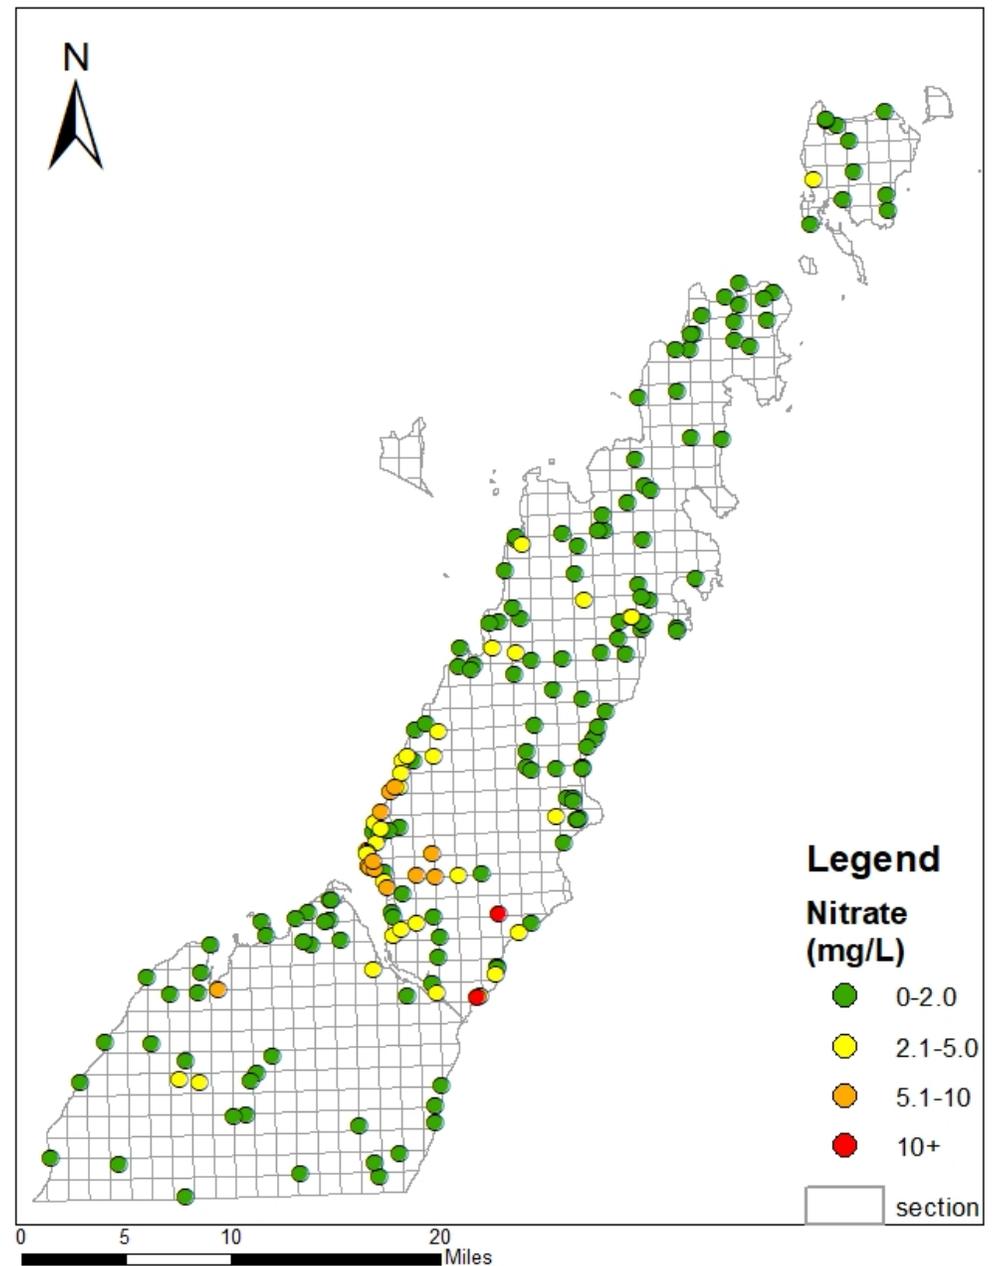

# Arsenic

| Arsenic Result ( $\mu\text{g/L}$ ) | # Samples | % Samples |
|------------------------------------|-----------|-----------|
| Less than 2                        | 146       | 92        |
| 2-5                                | 11        | 7         |
| 5-10                               | 1         | 1         |
| 10+                                | 0         | 0         |
| n=158                              |           |           |

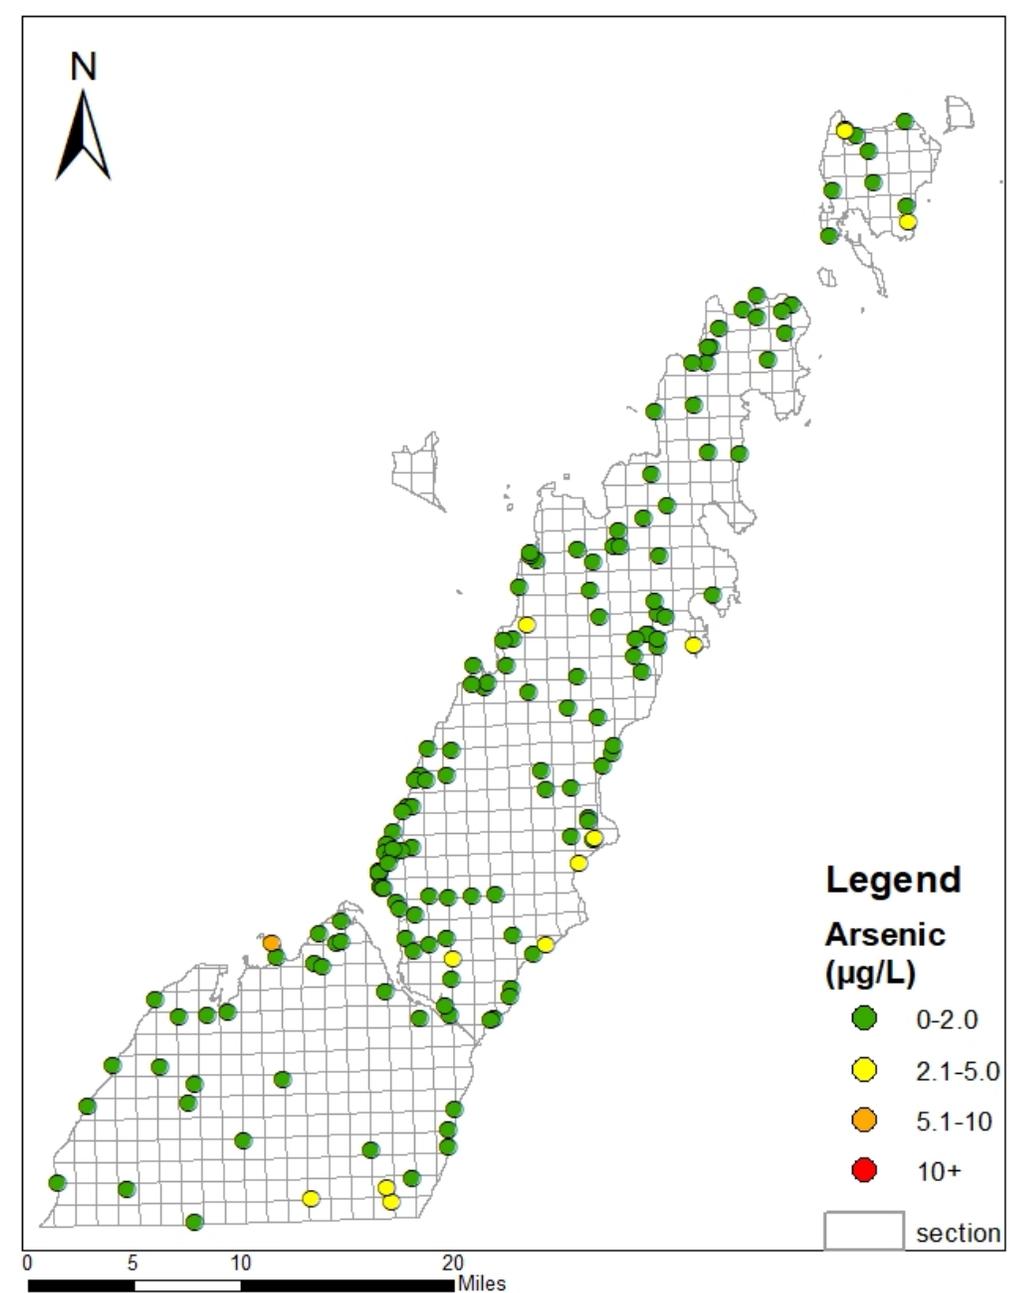

# Previous Data

---






# Fall 2019- 2022 Coliform Bacteria

## Legend

Total Coliform  
(MPN/100mL)

- 0
- 1.0-10.0
- 10.1-100
- 101+
- section

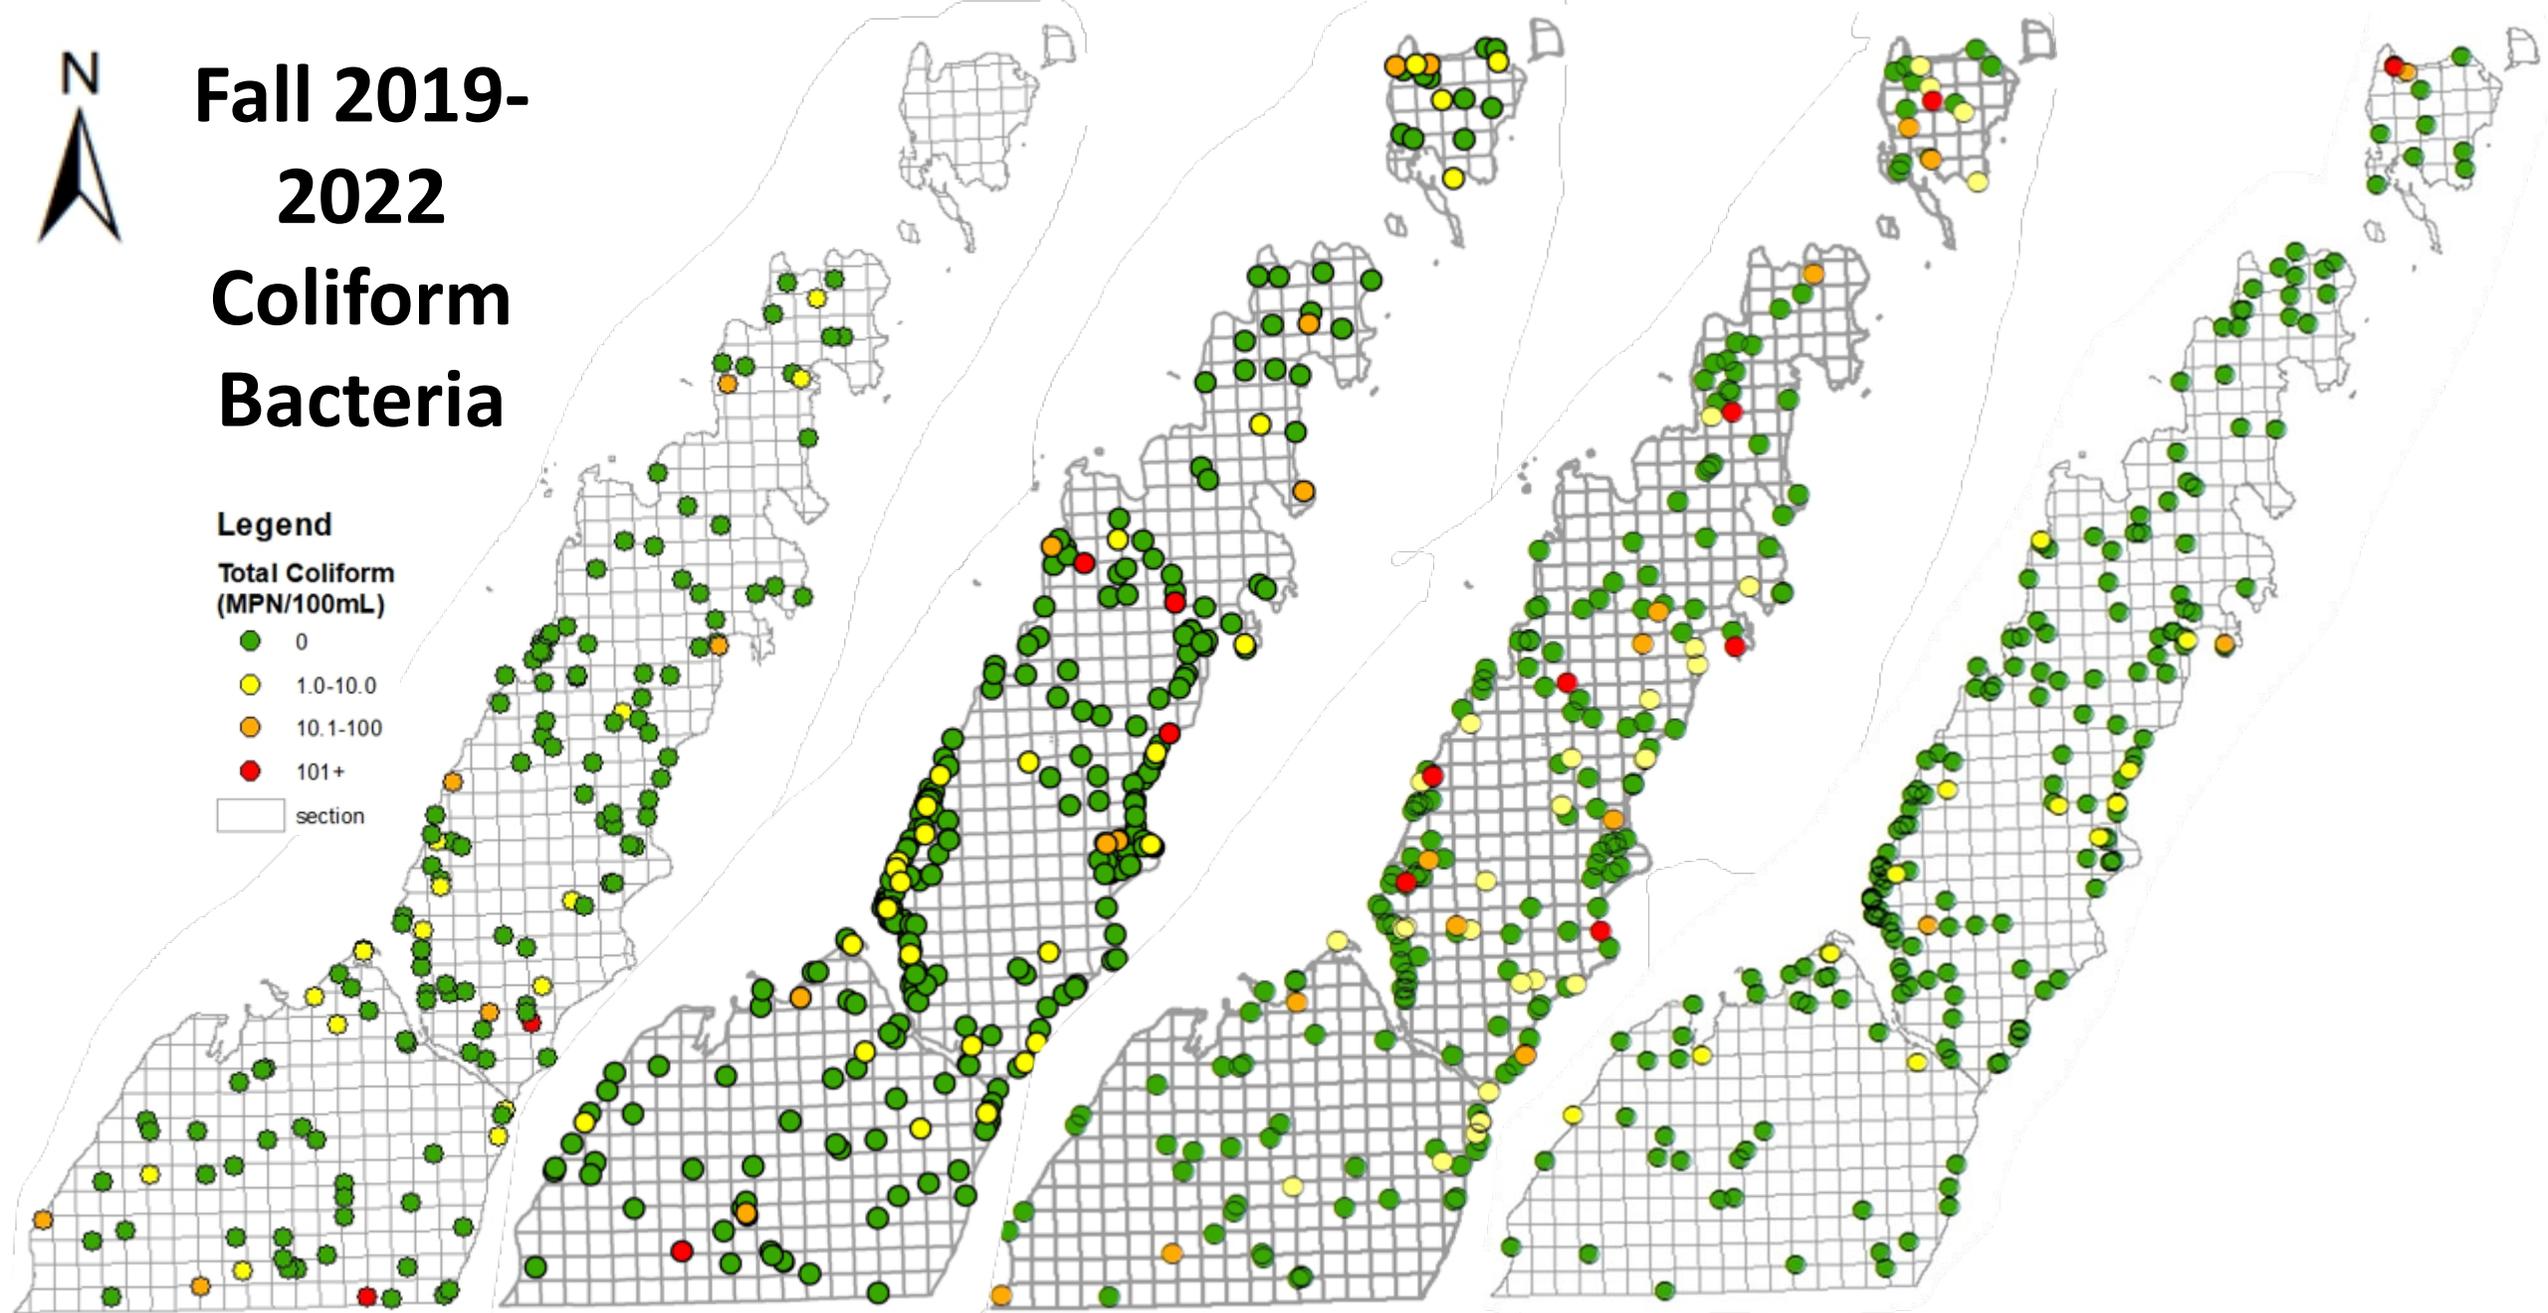

2019

2020

2021

2022




# Spring vs Fall 2022 Coliform Bacteria

## Legend

Total Coliform  
(MPN/100mL)

- 0
- 1.0-10.0
- 10.1-100
- 101+

section

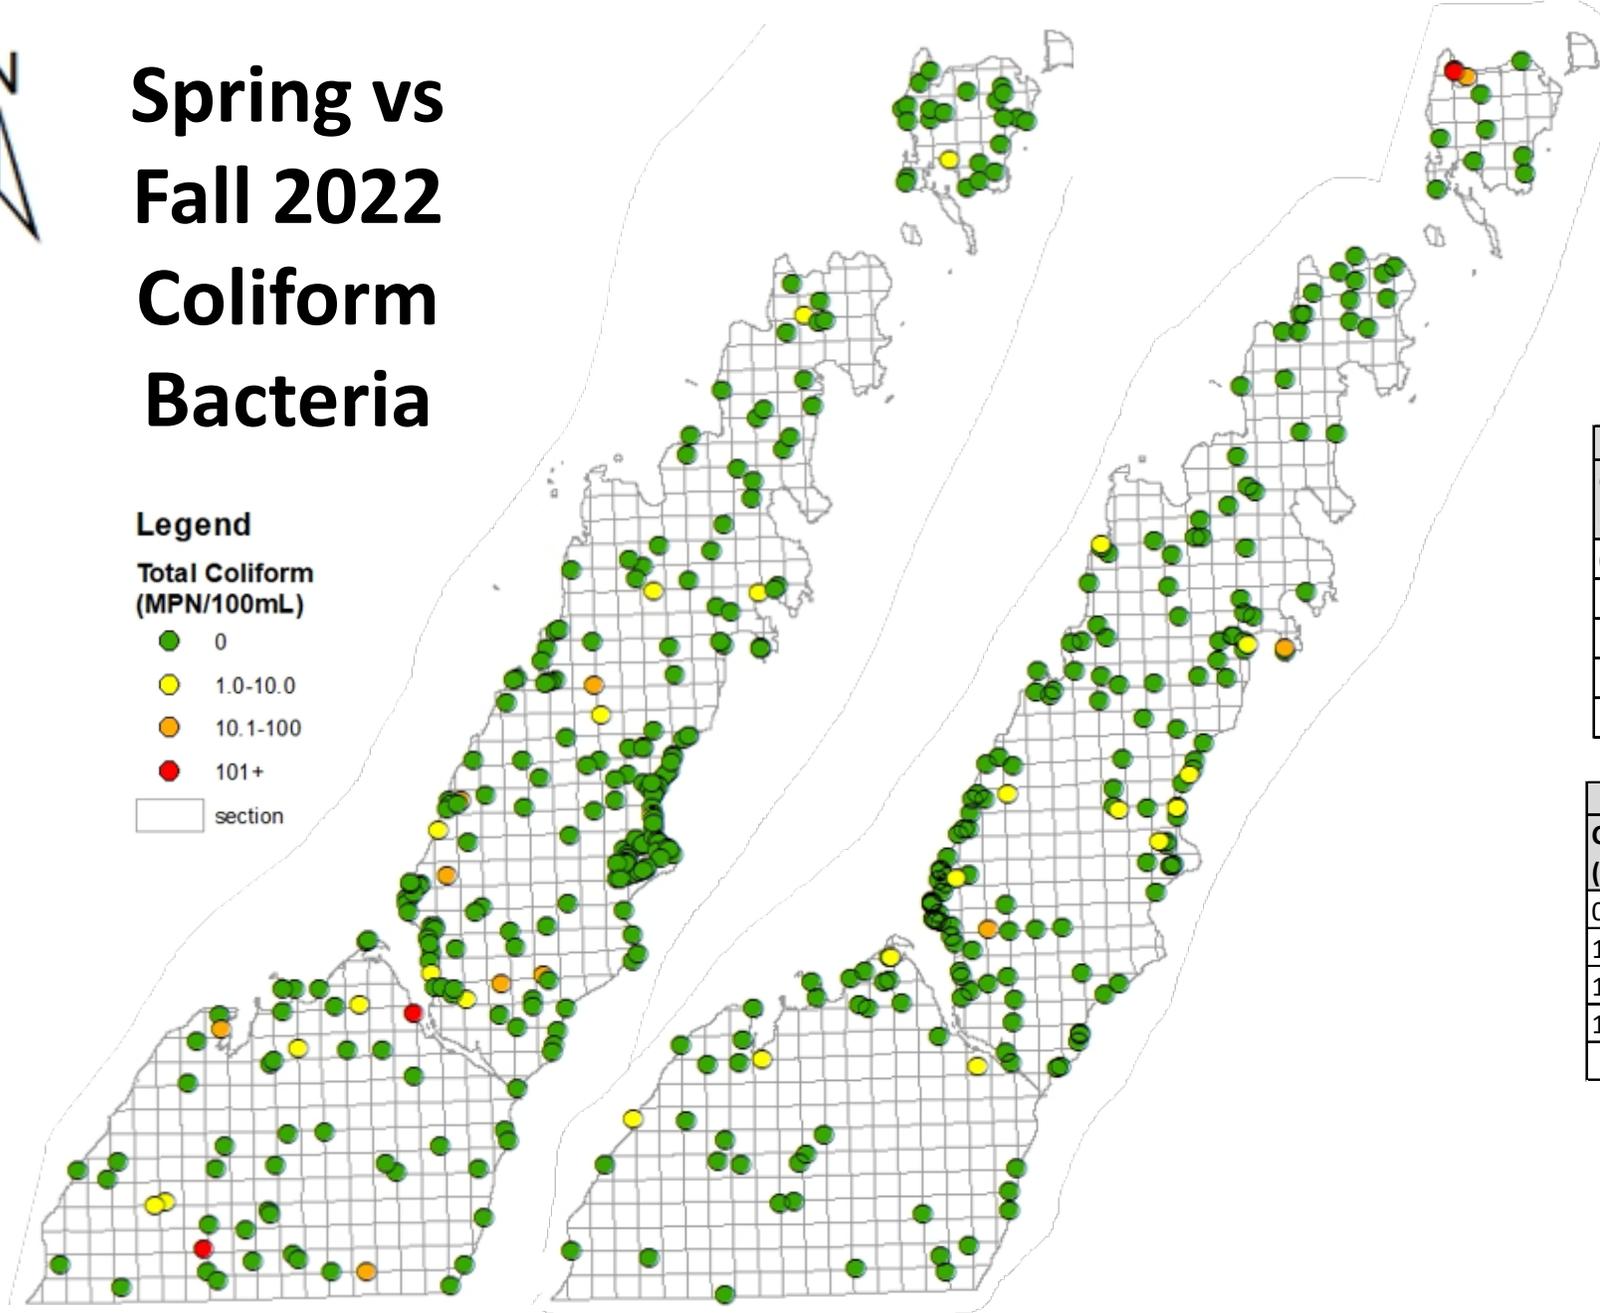

| Spring 2022                  |           |           |
|------------------------------|-----------|-----------|
| Coliform Result (MPN/100 mL) | # Samples | % Samples |
| 0                            | 234       | 90        |
| 1-10                         | 16        | 6         |
| 10-100                       | 8         | 3         |
| 100+                         | 2         | 1         |
| n=260                        |           |           |

| Fall 2022                    |           |           |
|------------------------------|-----------|-----------|
| Coliform Result (MPN/100 mL) | # Samples | % Samples |
| 0                            | 180       | 92        |
| 1-10                         | 12        | 6         |
| 10-100                       | 3         | 2         |
| 100+                         | 1         | 1         |
| n=196                        |           |           |

Spring 2022

Fall 2022

# Coliform Bacteria

| 2019                         |           |           | 2020                         |           |           | 2021                         |           |           | 2022                         |           |           |
|------------------------------|-----------|-----------|------------------------------|-----------|-----------|------------------------------|-----------|-----------|------------------------------|-----------|-----------|
| Coliform Result (MPN/100 mL) | # Samples | % Samples | Coliform Result (MPN/100 mL) | # Samples | % Samples | Coliform Result (MPN/100 mL) | # Samples | % Samples | Coliform Result (MPN/100 mL) | # Samples | % Samples |
| 0                            | 125       | 84        | 0                            | 254       | 86        | 0                            | 166       | 76        | 0                            | 180       | 92        |
| 1-10                         | 15        | 10        | 1-10                         | 28        | 9         | 1-10                         | 30        | 14        | 1-10                         | 12        | 6         |
| 10-100                       | 6         | 4         | 10-100                       | 9         | 3         | 10-100                       | 14        | 6         | 10-100                       | 3         | 2         |
| 100+                         | 2         | 1         | 100+                         | 4         | 1         | 100+                         | 7         | 3         | 100+                         | 1         | 1         |
| n=148                        |           |           | n=295                        |           |           | n=217                        |           |           | n=196                        |           |           |

Potential sampling errors? (Sample faucets must be properly disinfected)




# Fall 2019- 2022 *E. coli* Bacteria

## Legend

*E. coli*  
(MPN/100mL)

- 0
- 1.0-10.0
- 10.1-100
- 101+
- section

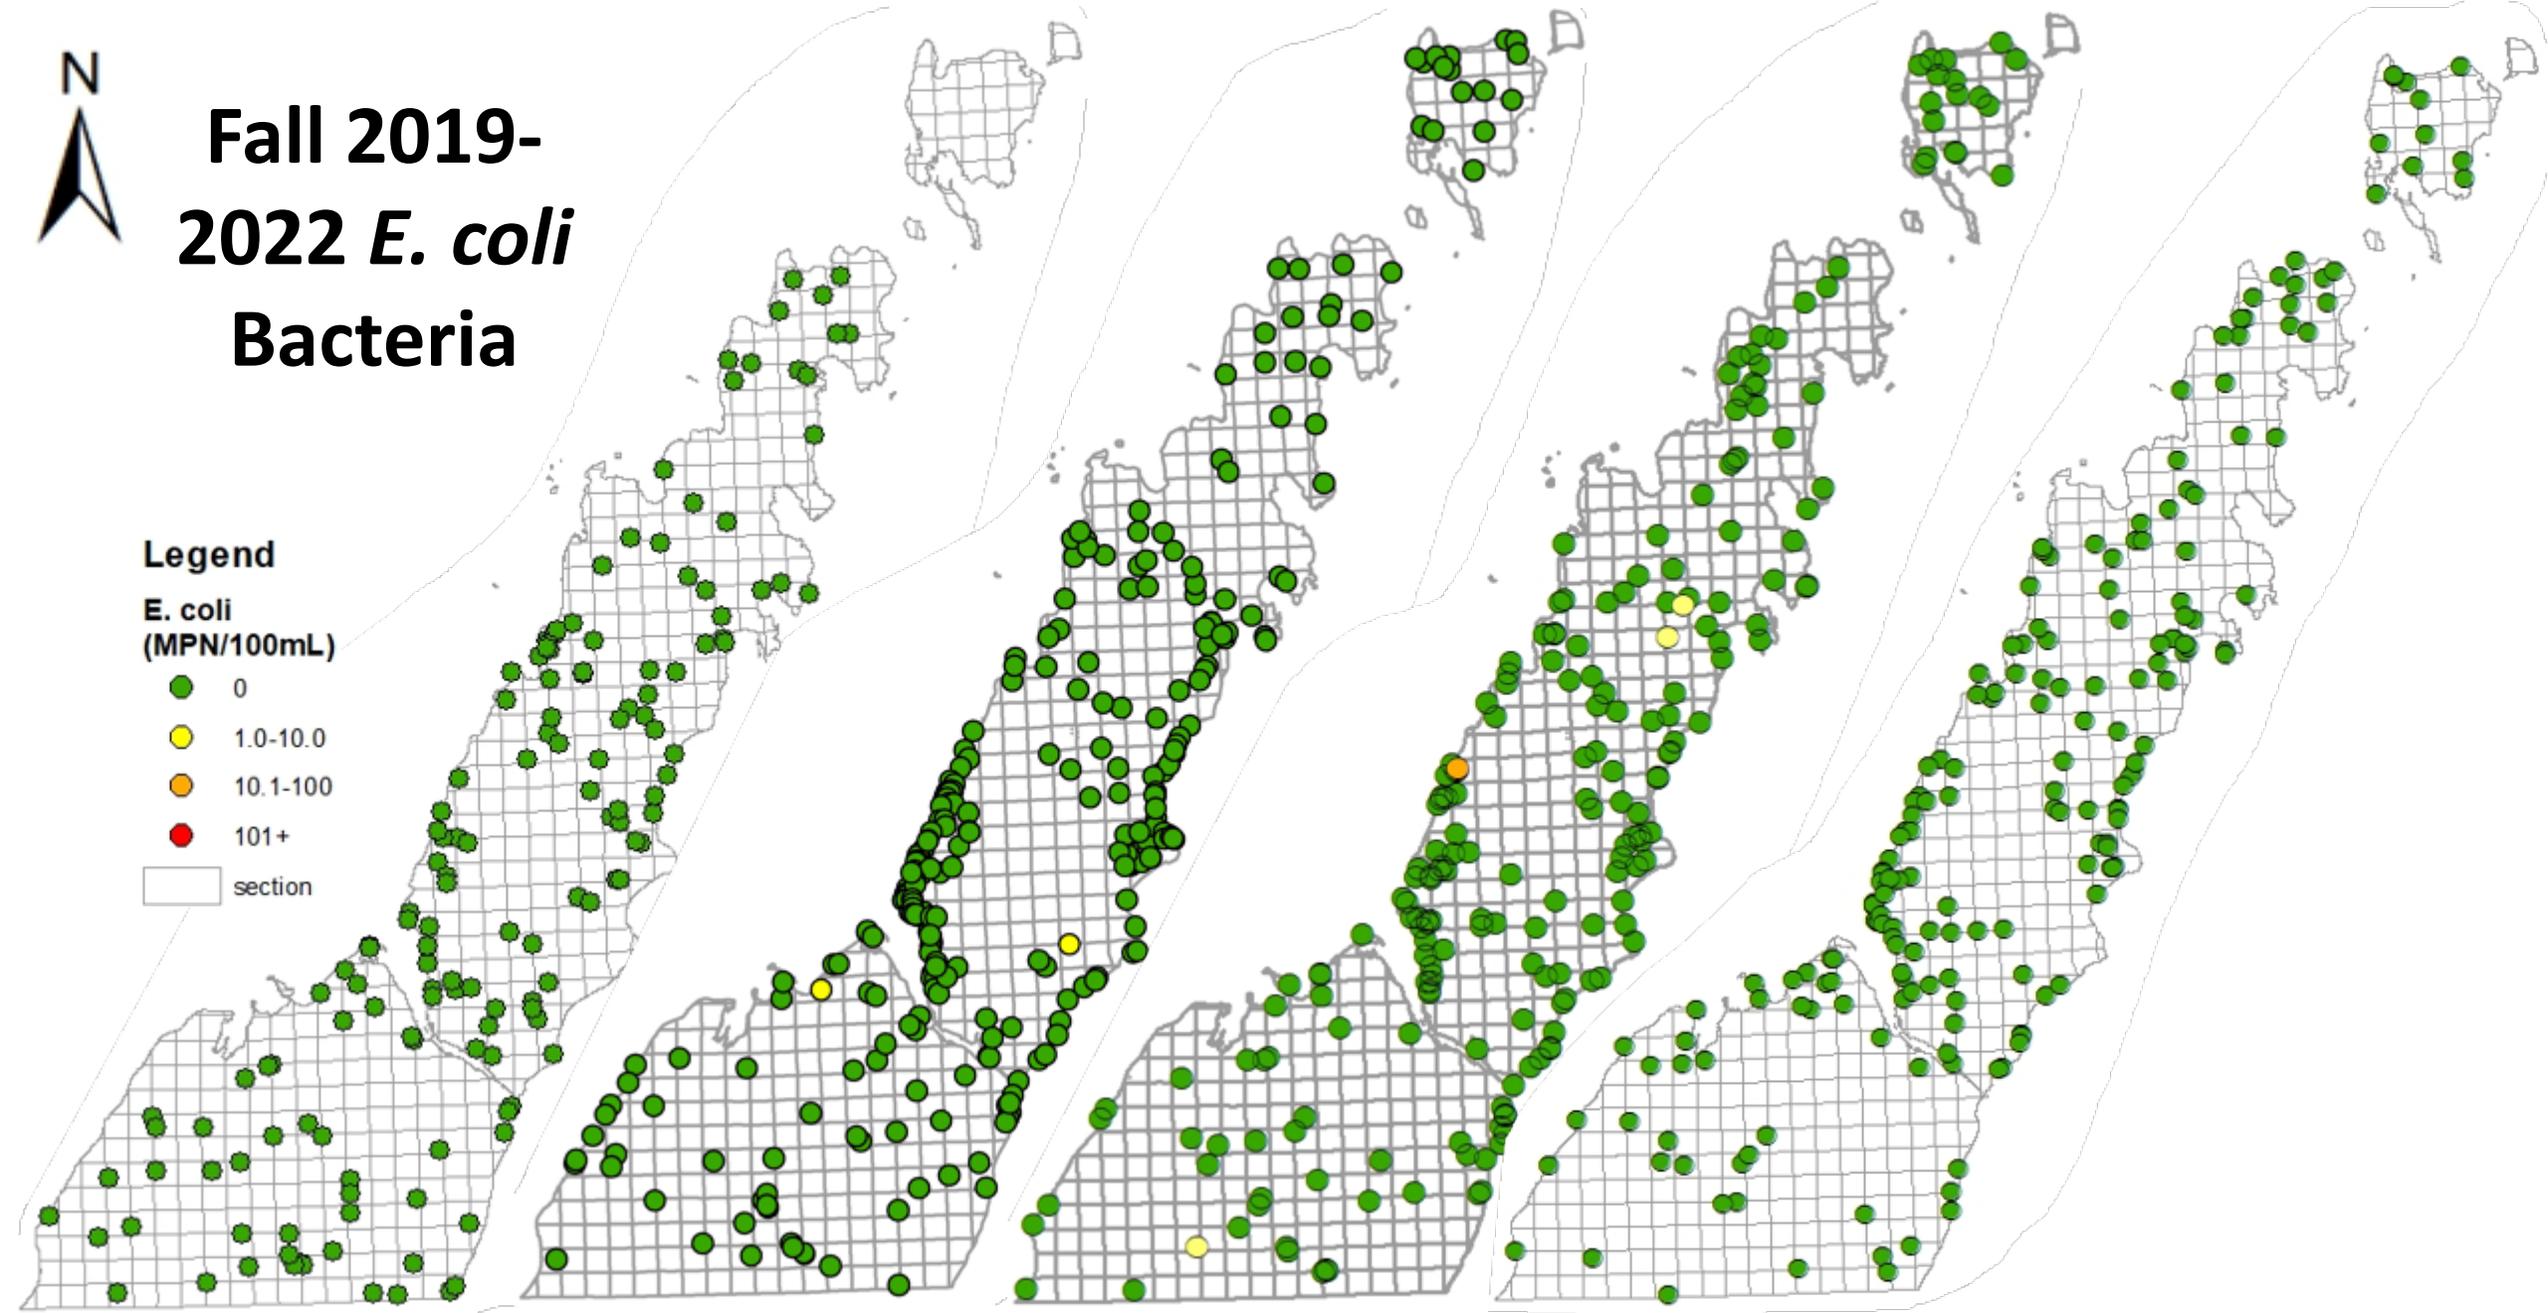

2019

2020

2021

2022




# Spring vs Fall 2022 *E. coli* Bacteria

## Legend

***E. coli***  
(MPN/100mL)

- 0
- 1.0-10.0
- 10.1-100
- 101+
- section

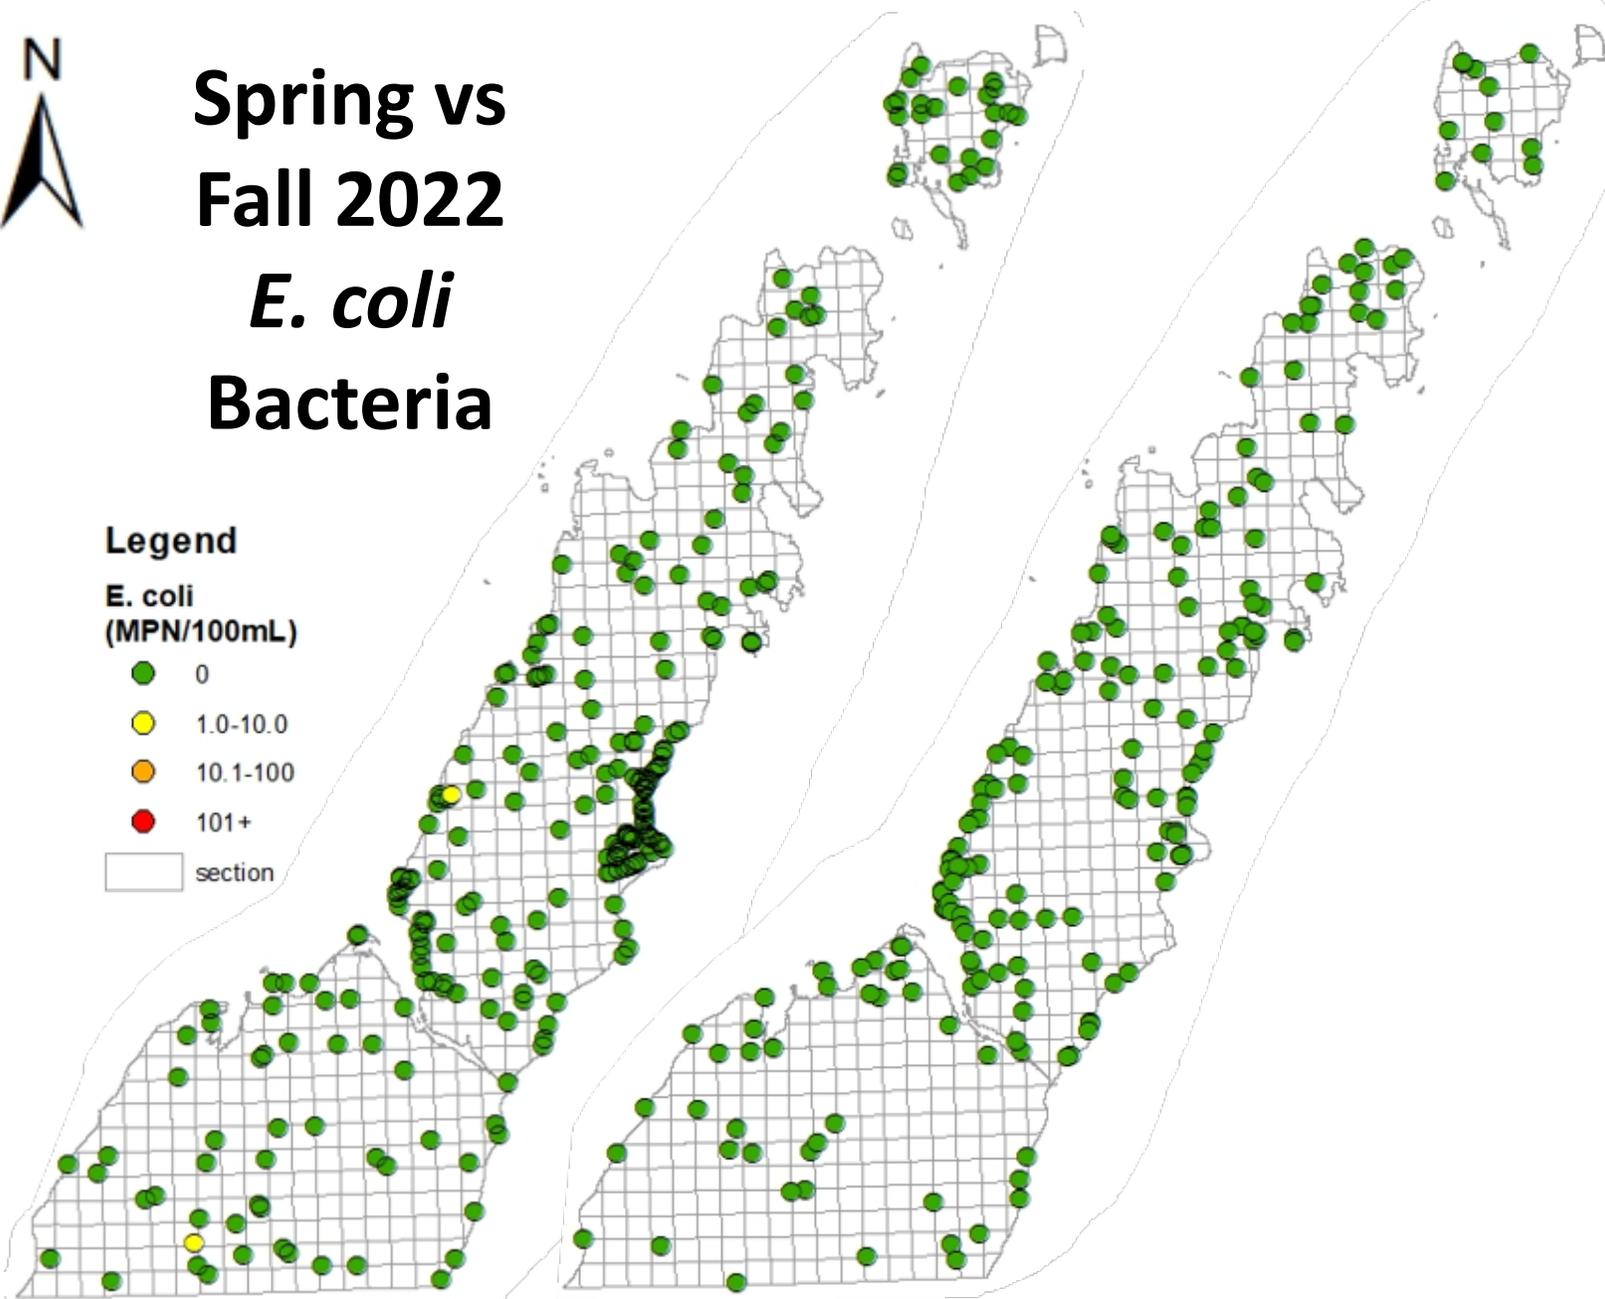

Spring 2022

Fall 2022

| Spring 2022                        |           |           |
|------------------------------------|-----------|-----------|
| <i>E. coli</i> Result (MPN/100 mL) | # Samples | % Samples |
| 0                                  | 259       | 100       |
| 1-10                               | 2         | 1         |
| 10-100                             | 0         | 0         |
| 100+                               | 0         | 0         |
| n=260                              |           |           |

| Fall 2022                          |           |           |
|------------------------------------|-----------|-----------|
| <i>E. coli</i> Result (MPN/100 mL) | # Samples | % Samples |
| 0                                  | 196       | 100       |
| 1-10                               | 0         | 0         |
| 10-100                             | 0         | 0         |
| 100+                               | 0         | 0         |
| n=196                              |           |           |

# *E. coli* Bacteria

---

| 2019                              |           |           | 2020                              |           |           | 2021                              |           |           | 2022                              |           |           |
|-----------------------------------|-----------|-----------|-----------------------------------|-----------|-----------|-----------------------------------|-----------|-----------|-----------------------------------|-----------|-----------|
| <i>E coli</i> Result (MPN/100 mL) | # Samples | % Samples | <i>E coli</i> Result (MPN/100 mL) | # Samples | % Samples | <i>E coli</i> Result (MPN/100 mL) | # Samples | % Samples | <i>E coli</i> Result (MPN/100 mL) | # Samples | % Samples |
| 0                                 | 148       | 100       | 0                                 | 293       | 99        | 0                                 | 213       | 98        | 0                                 | 196       | 100       |
| 1-10                              | 0         | 0         | 1-10                              | 2         | 1         | 1-10                              | 3         | 1         | 1-10                              | 0         | 0         |
| 10-100                            | 0         | 0         | 10-100                            | 0         | 0         | 10-100                            | 1         | <1        | 10-100                            | 0         | 0         |
| 100+                              | 0         | 0         | 100+                              | 0         | 0         | 100+                              | 0         | 0         | 100+                              | 0         | 0         |
| n=148                             |           |           | n=295                             |           |           | n=217                             |           |           | n=196                             |           |           |



# Fall 2019- 2022 Nitrate

## Legend

Nitrate as N  
(mg/L)


● 0-2.0

● 2.1-5.0

● 5.1-10

● 10+

□ section

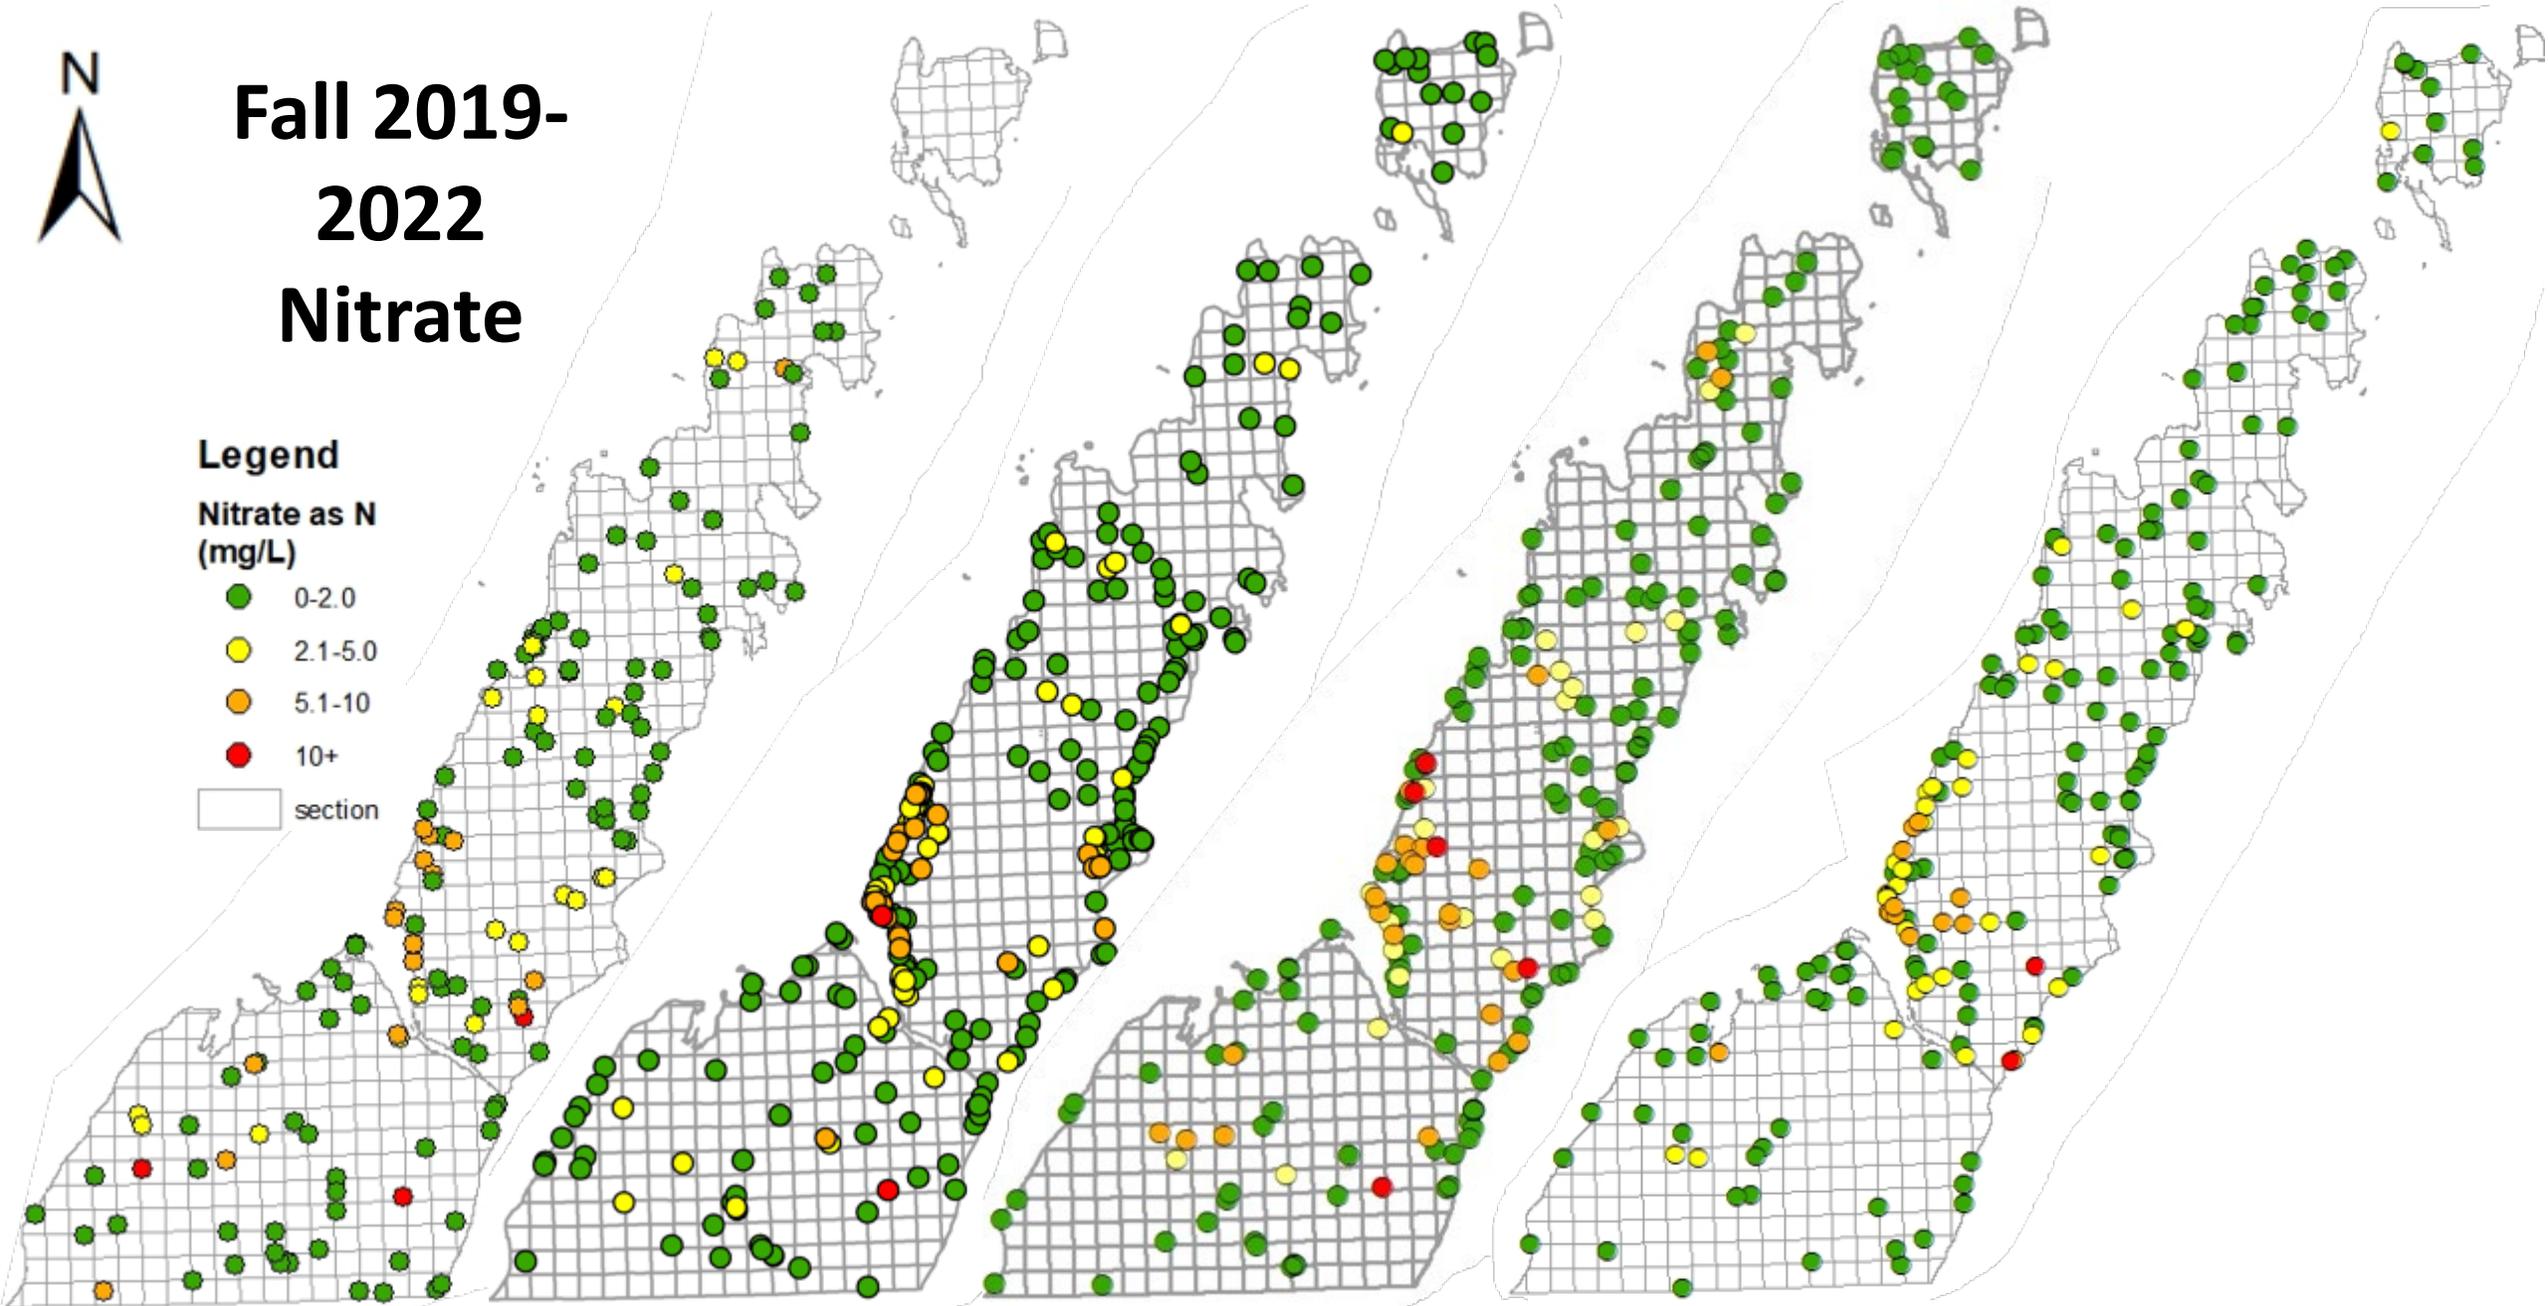

2019

2020

2021

2022




# Spring vs Fall 2022 Nitrate

## Legend

Nitrate as N  
(mg/L)

- 0-2.0
- 2.1-5.0
- 5.1-10
- 10+

section

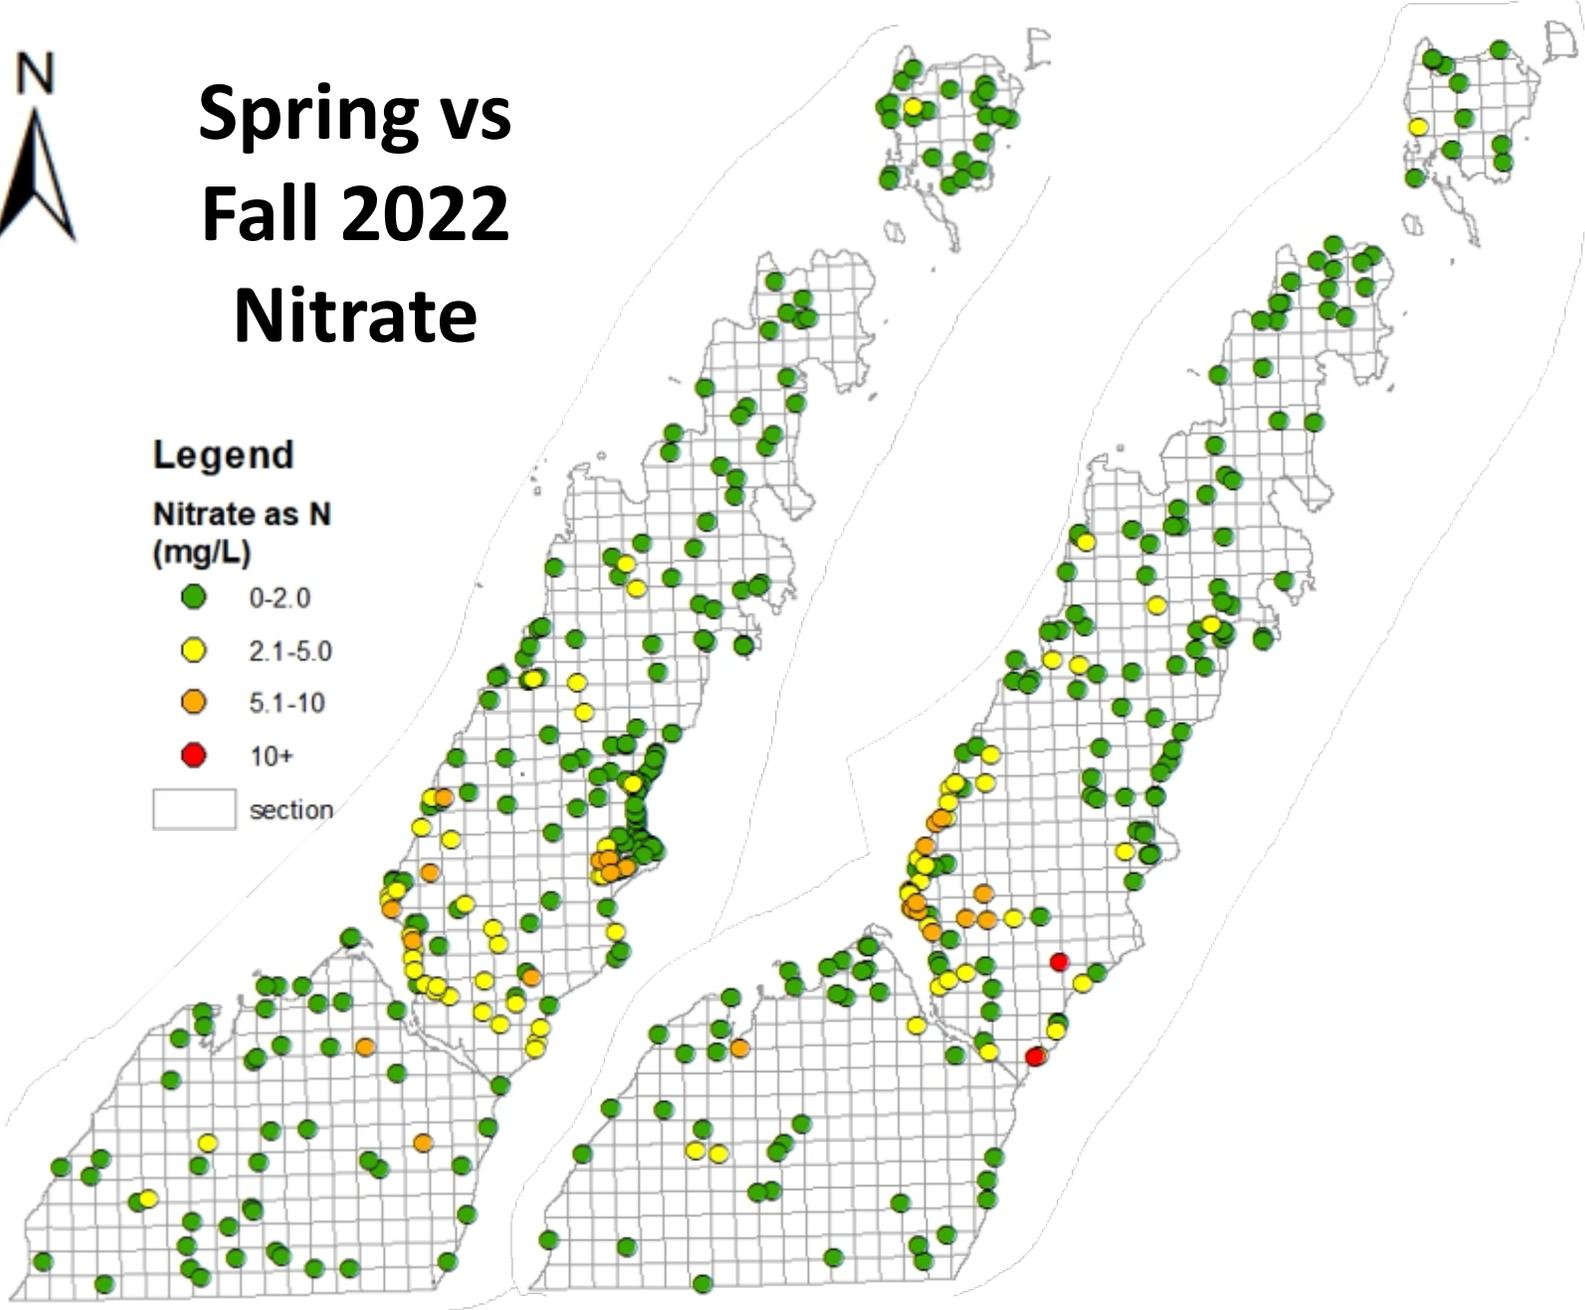

| Spring 2022           |           |           |
|-----------------------|-----------|-----------|
| Nitrate Result (mg/L) | # Samples | % Samples |
| Less than 2           | 203       | 80        |
| 2-5                   | 41        | 16        |
| 5-10                  | 11        | 4         |
| 10+                   | 0         | 0         |
| n=255                 |           |           |

| Fall 2022             |           |           |
|-----------------------|-----------|-----------|
| Nitrate Result (mg/L) | # Samples | % Samples |
| Less than 2           | 144       | 74        |
| 2-5                   | 35        | 18        |
| 5-10                  | 14        | 7         |
| 10+                   | 2         | 1         |
| n=195                 |           |           |

Spring 2022

Fall 2022

# Nitrate

---

| 2019                  |           |           | 2020                  |           |           | 2021                  |           |           | 2022                  |           |           |
|-----------------------|-----------|-----------|-----------------------|-----------|-----------|-----------------------|-----------|-----------|-----------------------|-----------|-----------|
| Nitrate Result (mg/L) | # Samples | % Samples | Nitrate Result (mg/L) | # Samples | % Samples | Nitrate Result (mg/L) | # Samples | % Samples | Nitrate Result (mg/L) | # Samples | % Samples |
| Less than 2           | 104       | 71        | Less than 2           | 206       | 72        | Less than 2           | 157       | 75        | Less than 2           | 144       | 74        |
| 2-5                   | 23        | 16        | 2-5                   | 46        | 16        | 2-5                   | 23        | 11        | 2-5                   | 35        | 18        |
| 5-10                  | 16        | 11        | 5-10                  | 34        | 12        | 5-10                  | 25        | 12        | 5-10                  | 14        | 7         |
| 10+                   | 3         | 2         | 10+                   | 2         | 1         | 10+                   | 5         | 2         | 10+                   | 2         | 1         |
| n=146                 |           |           | n=288                 |           |           | n=210                 |           |           | n=195                 |           |           |




# Fall 2019- 2022 Arsenic

## Legend

Arsenic  
( $\mu\text{g/L}$ )

- 0-2.0
- 2.1-5.0
- 5.1-10
- 10+

section

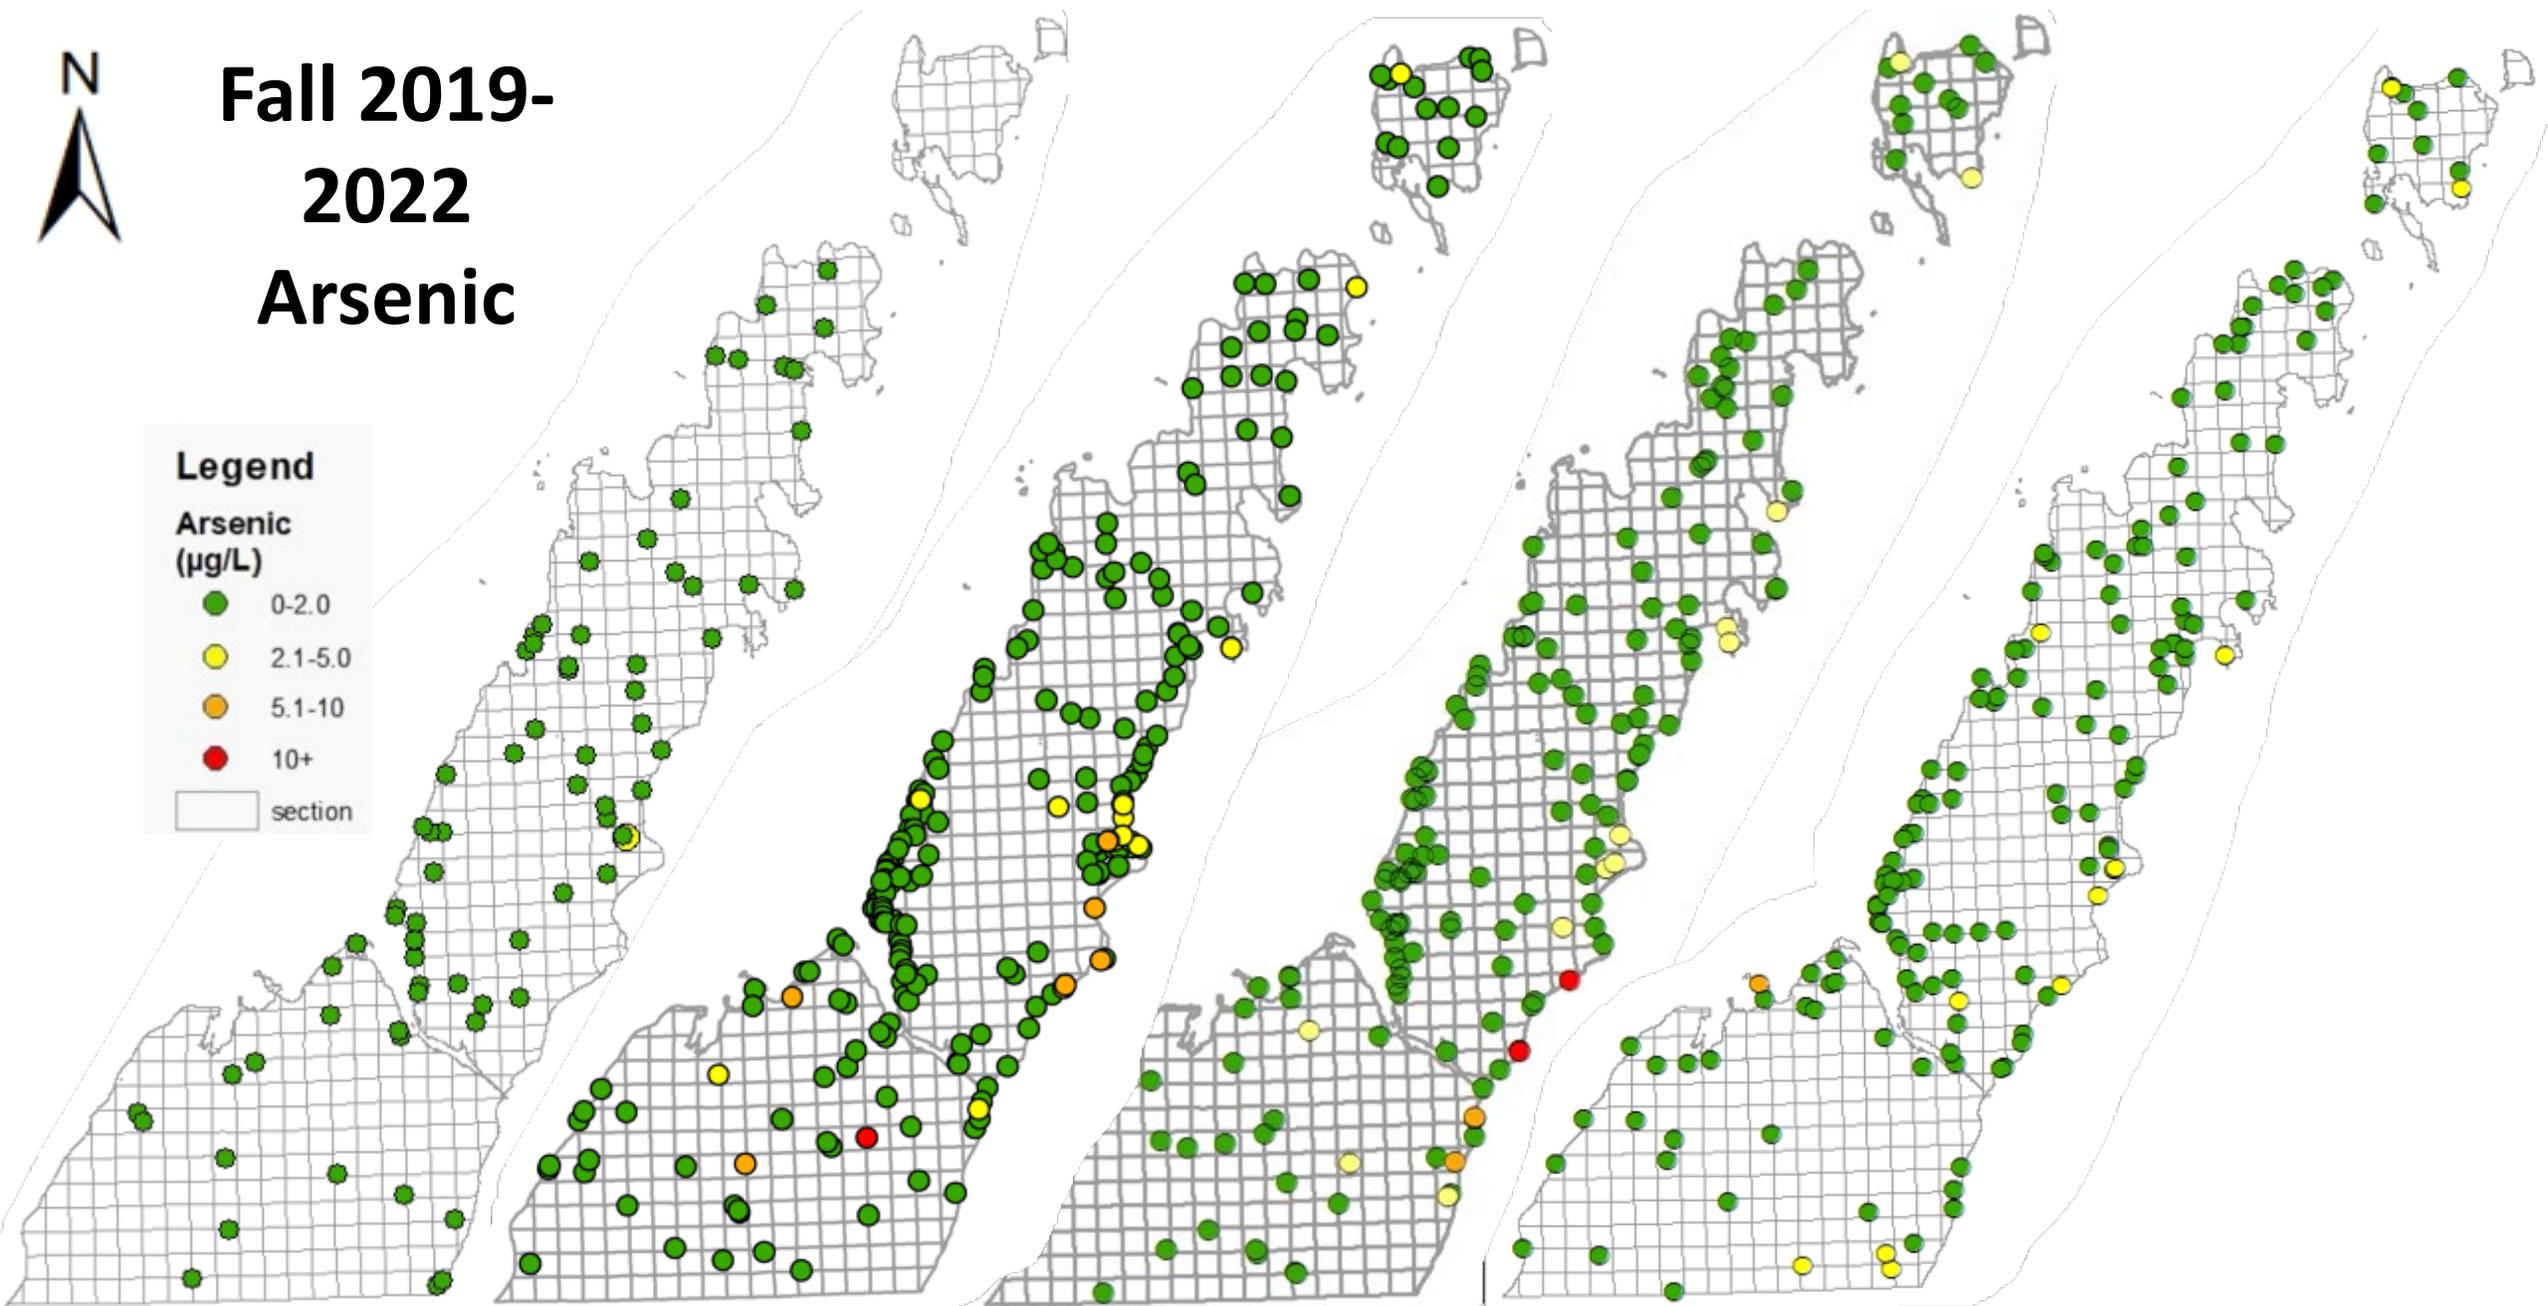

2019

2020

2021

2022




# Spring vs Fall 2022 Arsenic

## Legend

Arsenic  
( $\mu\text{g/L}$ )

- 0-2.0
- 2.1-5.0
- 5.1-10
- 10+
- section

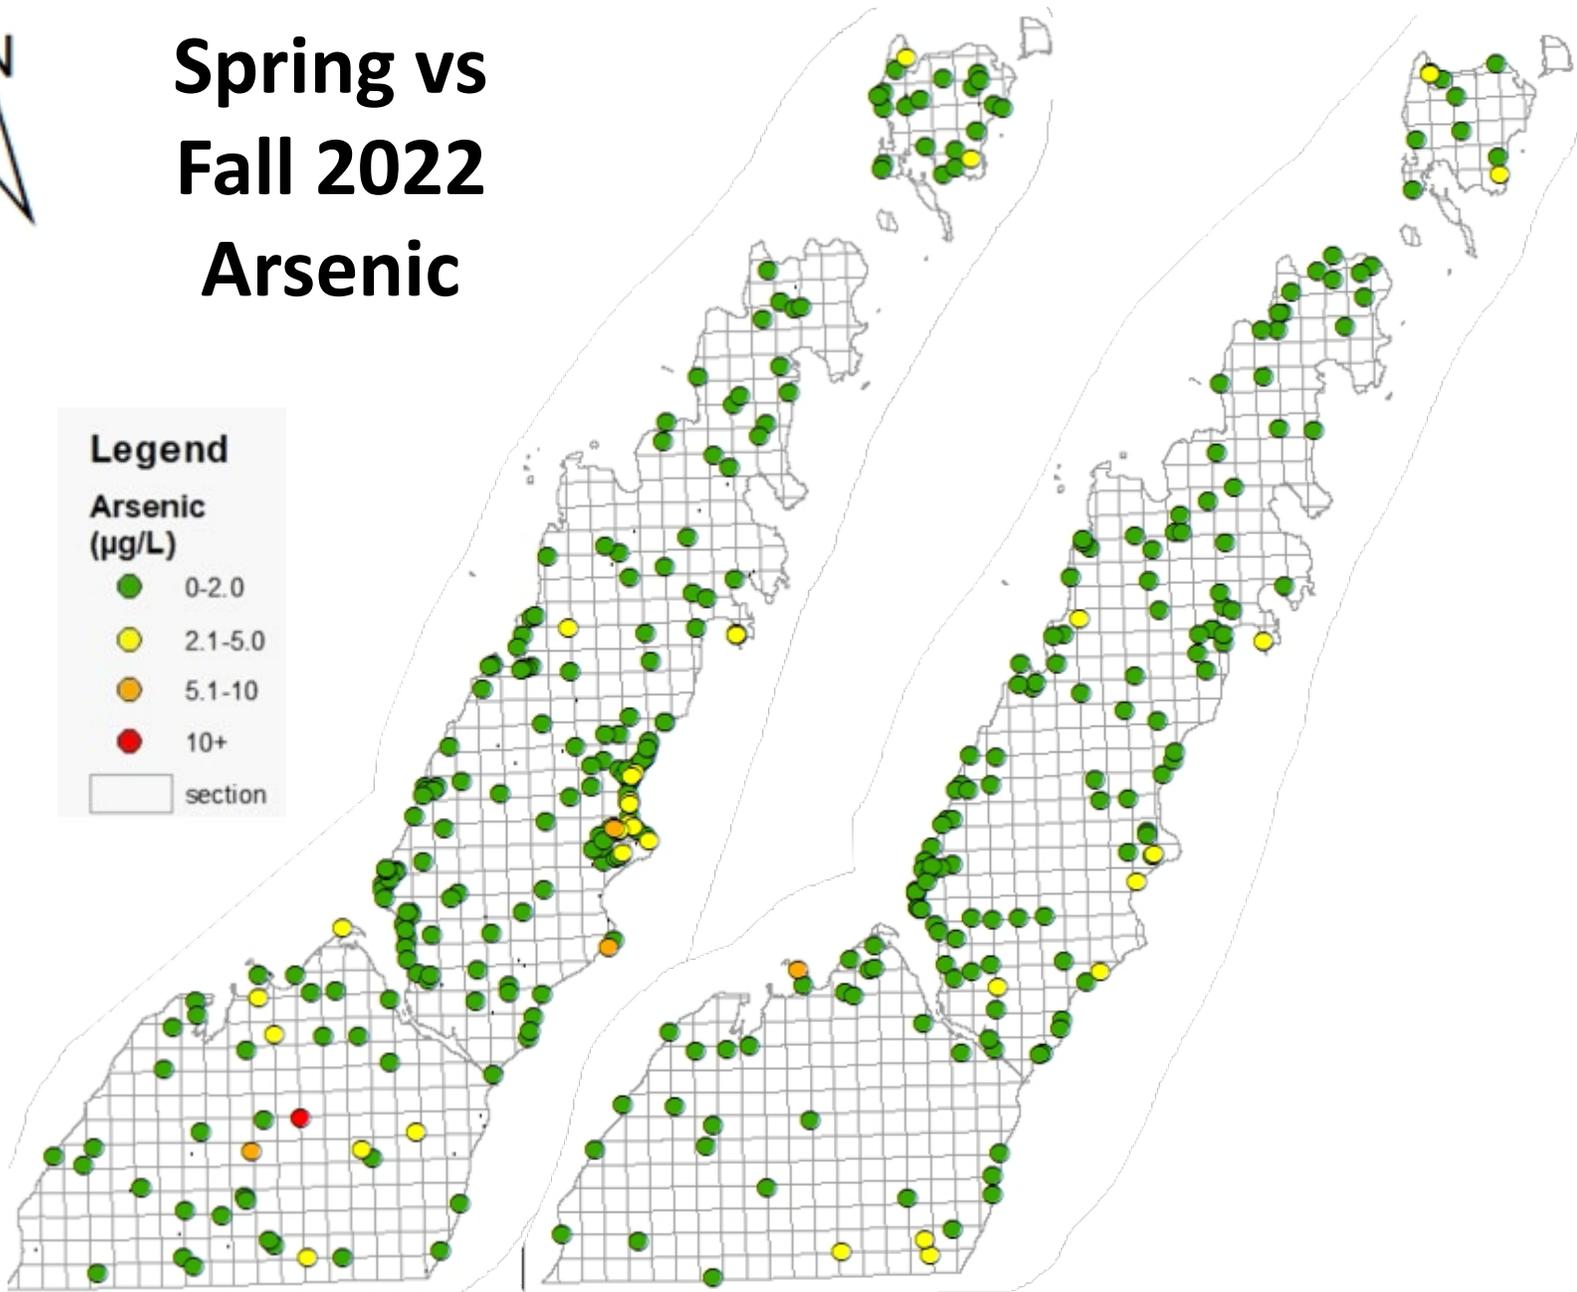

| Spring 2022                        |           |           |
|------------------------------------|-----------|-----------|
| Arsenic Result ( $\mu\text{g/L}$ ) | # Samples | % Samples |
| Less than 2                        | 182       | 88        |
| 2-5                                | 22        | 11        |
| 5-10                               | 3         | 1         |
| 10+                                | 1         | 0         |
| n=208                              |           |           |

| Fall 2022                          |           |           |
|------------------------------------|-----------|-----------|
| Arsenic Result ( $\mu\text{g/L}$ ) | # Samples | % Samples |
| Less than 2                        | 146       | 92        |
| 2-5                                | 11        | 7         |
| 5-10                               | 1         | 1         |
| 10+                                | 0         | 0         |
| n=158                              |           |           |

Spring 2022

Fall 2022

# Arsenic

---

| 2019                  |           |           | 2020                  |           |           | 2021                  |           |           | 2022                  |           |           |
|-----------------------|-----------|-----------|-----------------------|-----------|-----------|-----------------------|-----------|-----------|-----------------------|-----------|-----------|
| Arsenic Result (µg/L) | # Samples | % Samples | Arsenic Result (µg/L) | # Samples | % Samples | Arsenic Result (µg/L) | # Samples | % Samples | Arsenic Result (µg/L) | # Samples | % Samples |
| Less than 2           | 70        | 99        | Less than 2           | 214       | 90        | Less than 2           | 149       | 89        | Less than 2           | 146       | 92        |
| 2-5                   | 1         | 1         | 2-5                   | 15        | 6         | 2-5                   | 15        | 9         | 2-5                   | 11        | 7         |
| 5-10                  | 0         | 0         | 5-10                  | 7         | 3         | 5-10                  | 2         | 1         | 5-10                  | 1         | 1         |
| 10+                   | 0         | 0         | 10+                   | 1         | <1        | 10+                   | 2         | 1         | 10+                   | 0         | 0         |
| n=71                  |           |           | n=237                 |           |           | n=168                 |           |           | n=158                 |           |           |


# County-Wide Sampling Efforts

| Percentage Exceeding Safe Water Quality Standards |                                     |                                     |                                     |                                     |  |             |
|---|-------------------------------------|-------------------------------------|-------------------------------------|-------------------------------------|--|-------------|
| Water Quality Standard                            | Fall 2022<br>Door County<br>Results | Fall 2021<br>Door County<br>Results | Fall 2020<br>Door County<br>Results | Fall 2019<br>Door County<br>Results | Previous<br>Door County<br>Results*<br>(Average) | Wisconsin** |
| Total Coliform (> 0 MPN/100 ml)                   | 8%                                  | 24%                                 | 14%                                 | 16%                                 | 18%  | 17%         |
| <i>E. coli</i> (> 0 MPN/100 ml)                   | 0%                                  | 2%                                  | 1%                                  | 0%                                  | 6%   | 5%          |
| Nitrate (> 10 mg/L)                               | 1%                                  | 2%                                  | 1%                                  | 2%                                  | 2%   | 8%          |
| Arsenic (> 10 µg/L)                               | 0%                                  | 1%                                  | <1%                                 | 0%                                  | 3%   | 5%          |

\*Data derived from UWSP Well Viewer, UWO 2015 (480 samples) & 2016 (392 samples) community program, 2011-2015 UWEx Private Well Program (582 samples)

\*\*Data derived from the Wisconsin Groundwater Coordinating Council Report & UWSP Well Viewer


## % Positive Bacteria

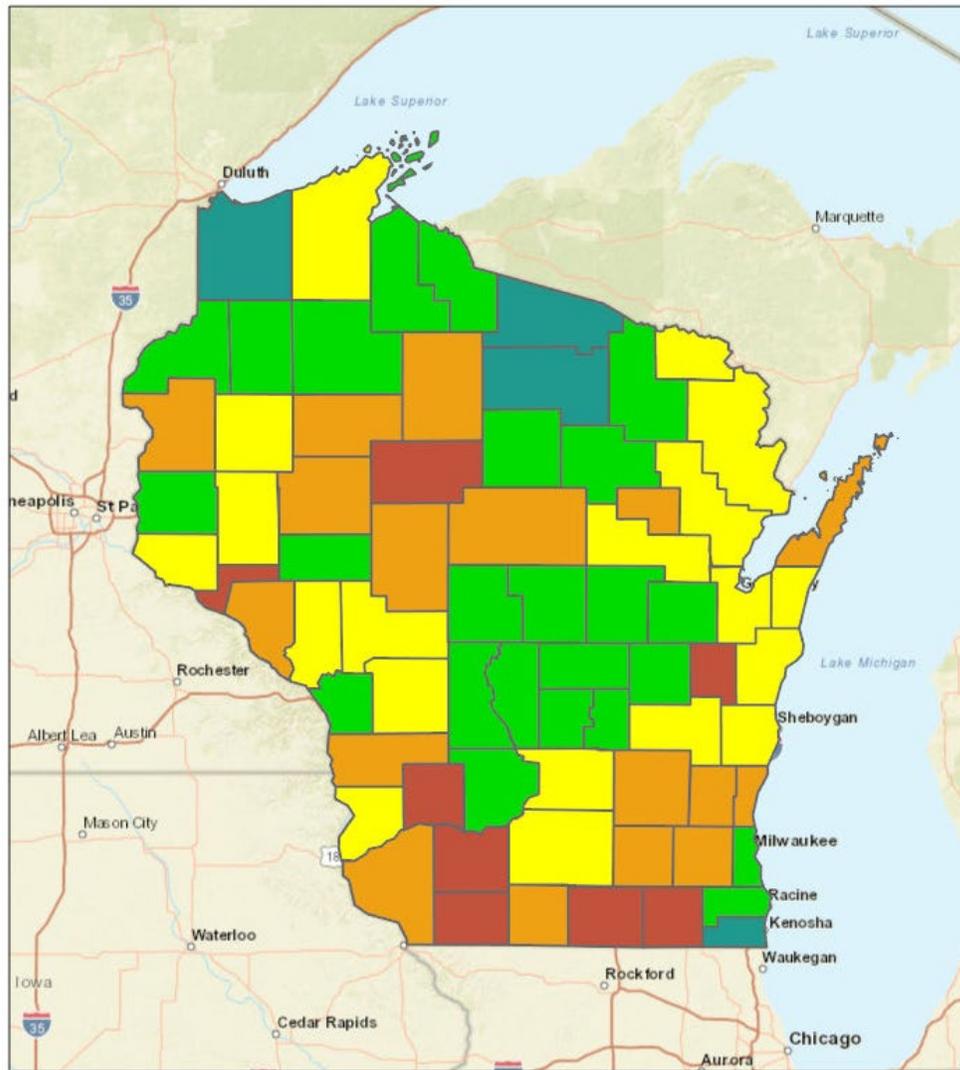

November 26, 2019


Bacteria - Percent - Positive by County

|   |
|---|
| <span style="color: yellow;">■</span> 15.1% - 20% |
| <span style="color: teal;">■</span> 5.1% - 10%    |
| <span style="color: green;">■</span> 10.1% - 15%  |
| <span style="color: brown;">■</span> 20.1% - 25%  |
| <span style="color: darkred;">■</span> 25.1% ...  |



Sources: Esri, HERE, Garmin, USGS, Intermap, INCREMENT P,...


## Average Nitrate

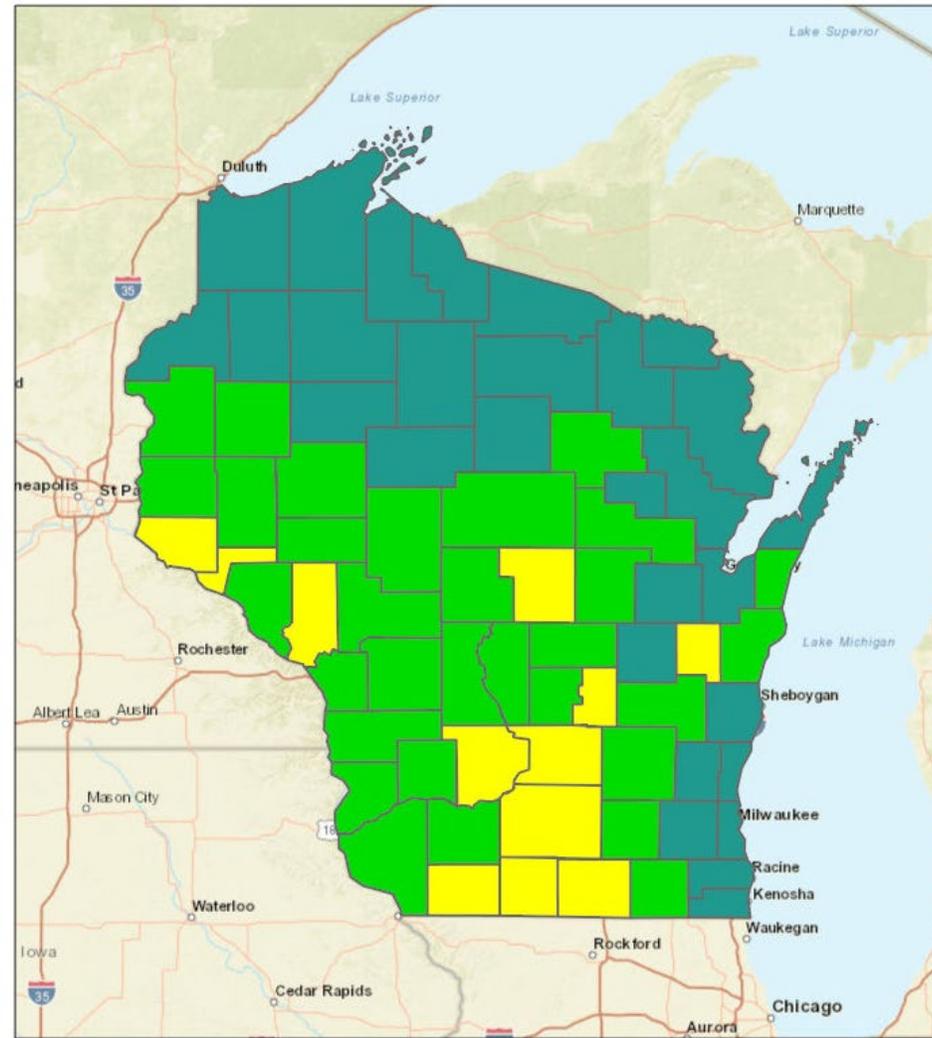

November 26, 2019

Nitrate - mg/l N - Average by County

|   |
|---|
| <span style="color: teal;">■</span> ... 2.0 mg/l as N |
| <span style="color: green;">■</span> 2.1 - 5.0        |
| <span style="color: yellow;">■</span> 5.1 - 10.0      |




Sources: Esri, HERE, Garmin, USGS, Intermap, INCREMENT P, NF Esri Japan, METI, Esri China (Hong Kong), Esri Korea, Esri (Thailand), NGCC, (c) OpenStreetMap contributors, and the GIS User Community

# Statewide Private Well Data


# Where is the data going?

- Long-term goal is to upload all data onto UWSP Well Water Data Viewer <https://www.uwsp.edu/cnr-ap/watershed/Pages/WellWaterViewer.aspx>

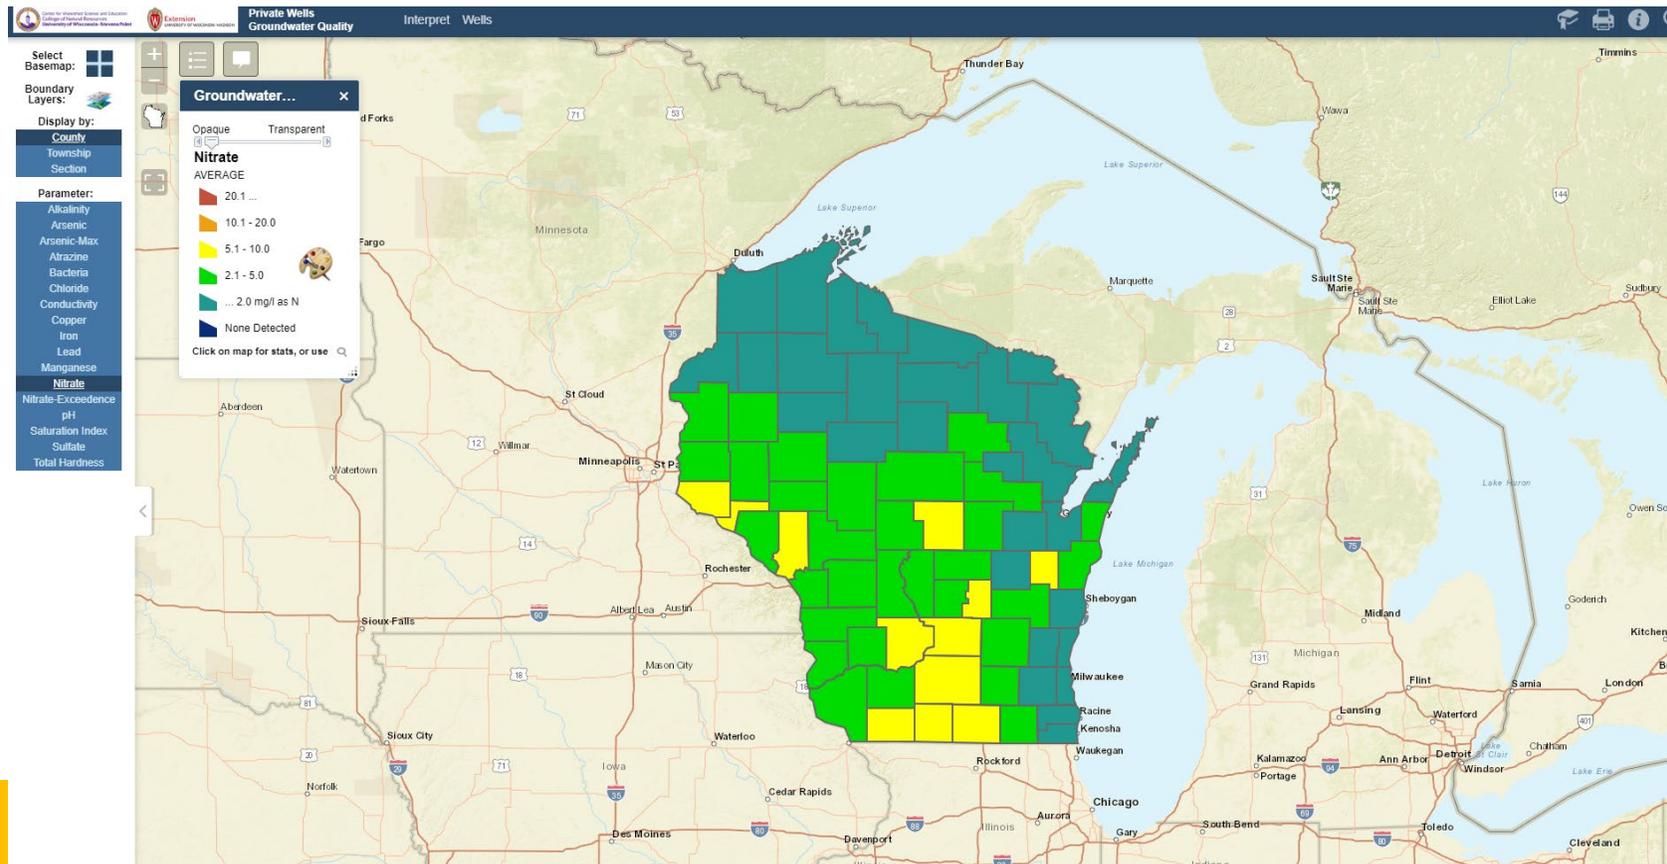

# Further Research & Plans

- Continue targeted sampling in spring, summer, and/or fall (seasonal)
- Recruiting same volunteers from previous years plus additional wells in other sections across county
- Continuation as a long-term study (ongoing annual program)

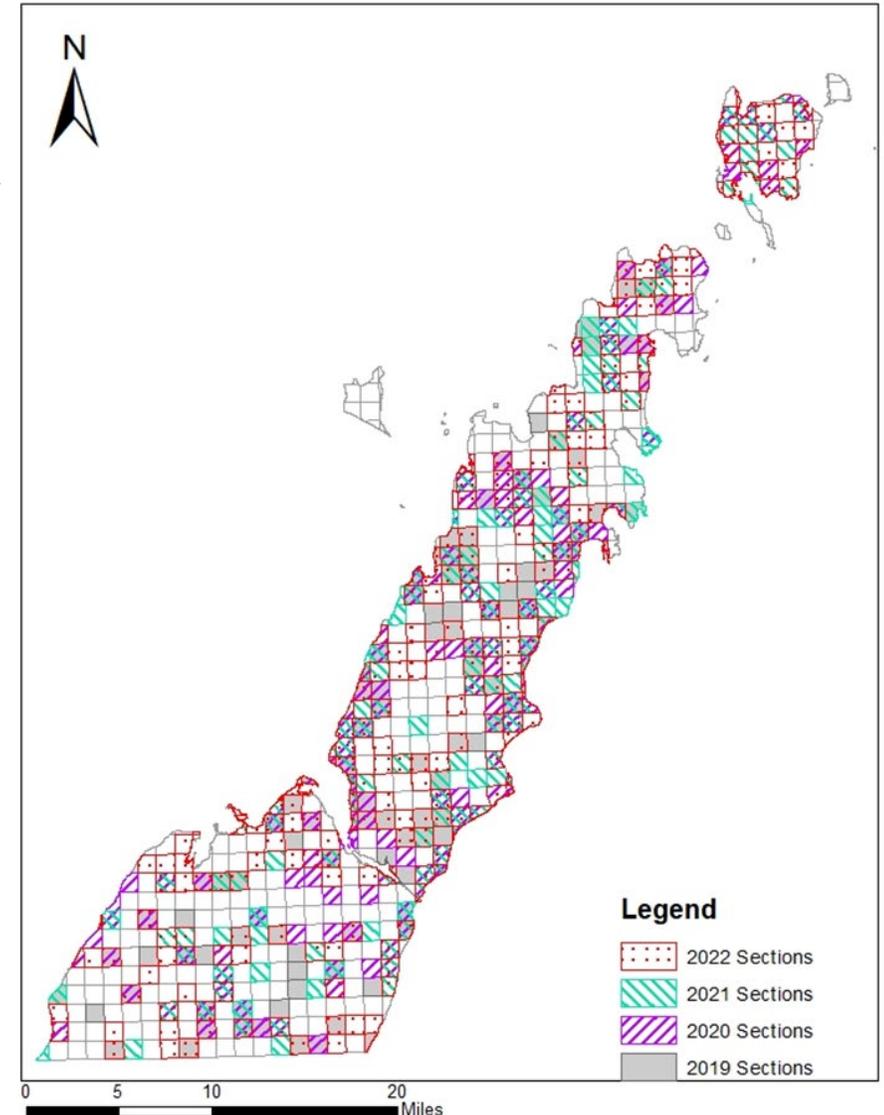

# Take Home Messages

---

- Karst geology makes Door County groundwater highly vulnerable to contamination and causes high variability in water quality results
- Sample your well at least annually for bacteria and nitrate, or more often if changes or problems observed (recommended)
- Do not hesitate to use your resources if you have questions or concerns about Door County groundwater quality
  - Wisconsin DNR
  - Door County Soil & Water Conservation Department
  - Door County Public Health

# Special Thanks

---

- Thank you to Door County Soil & Water Department and Door County Public Health for your support throughout the last 3 years of sampling

QUESTIONS? CONTACT  
US AT  
[ERIC@UWOSH.EDU](mailto:ERIC@UWOSH.EDU) OR  
(920) 424-3148

PRESENTATION &  
RECORDING AVAILABLE  
ONLINE AT  
[UWOSH.EDU/ERIC](http://UWOSH.EDU/ERIC)

**Thank you – we can't  
do this without you!**

Tell us how we did so we  
can continue to improve  
upon the program – a  
survey will be sent via  
email in the coming weeks.